


INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM -- FEBRUARY 2014

PS_RHIC

B4-q89 replaced
Yo1-th6 replaced

ACG_RHIC

7z1 gate voltage dropped
Unable to change RHIC mode to NA

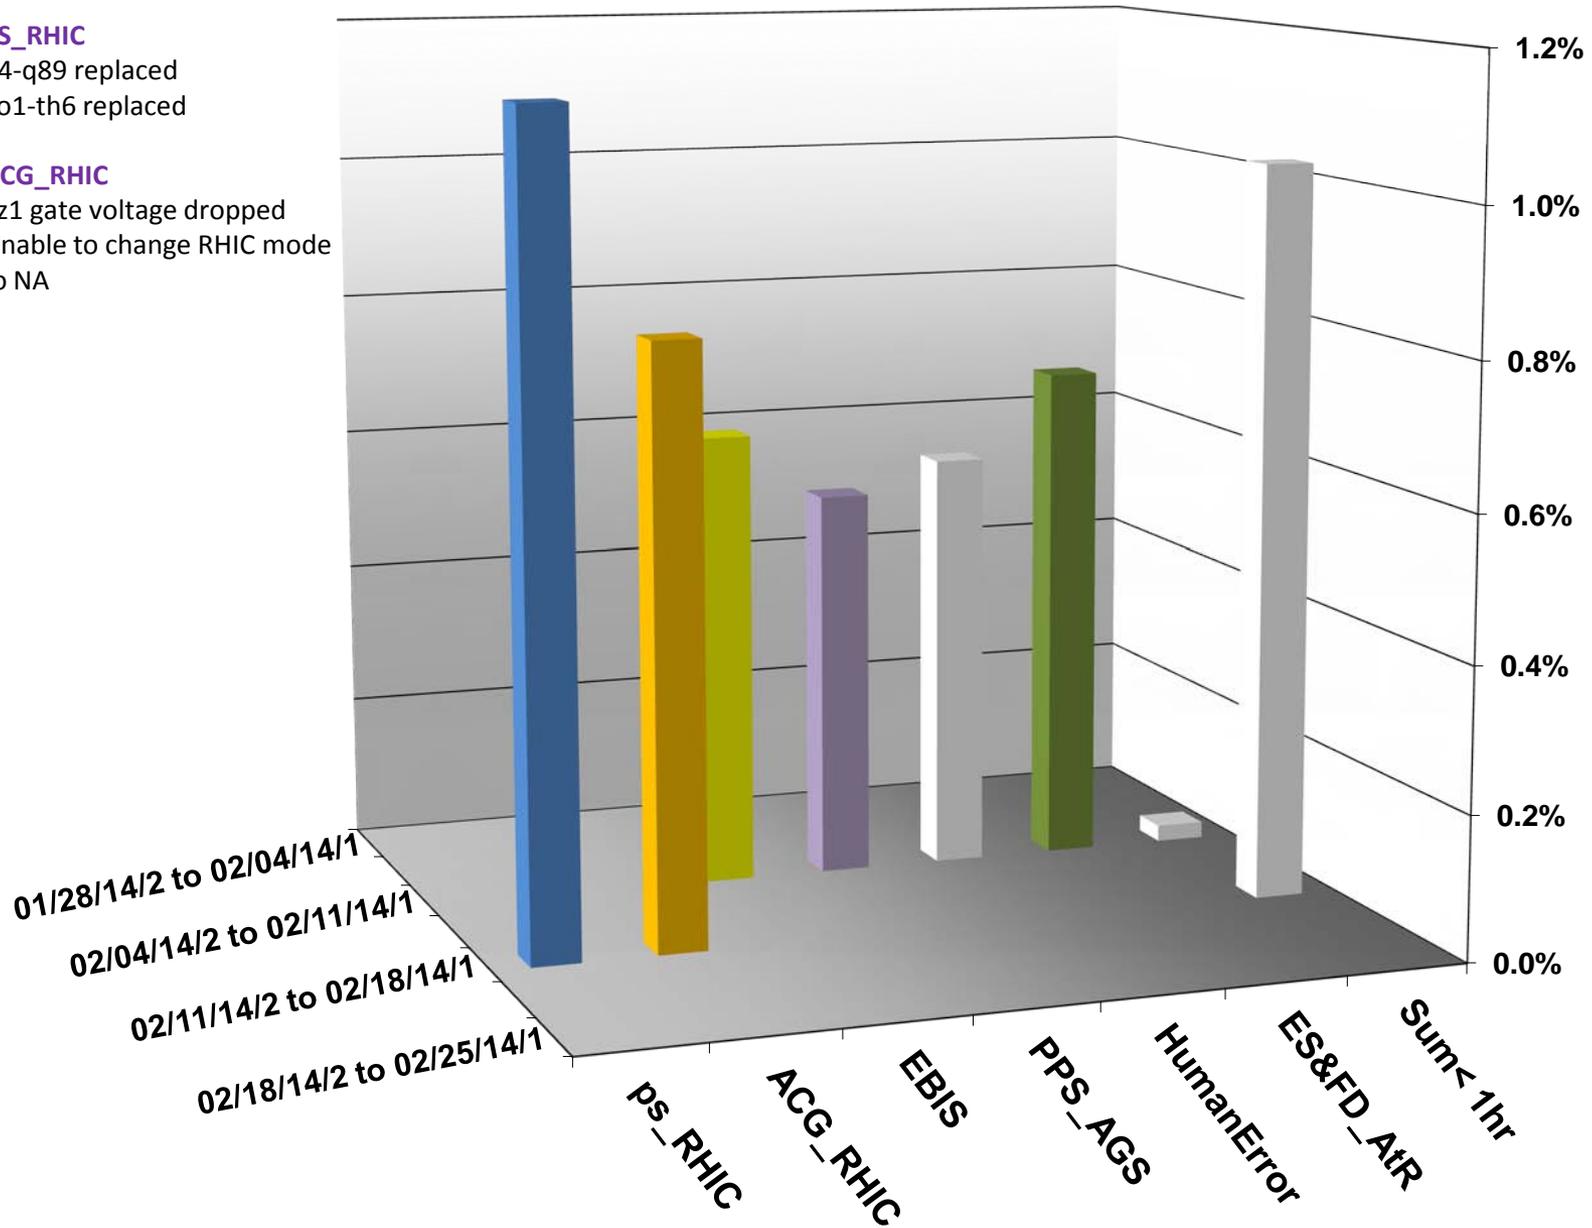

01/28/14/2 to 02/04/14/1

02/04/14/2 to 02/11/14/1

02/11/14/2 to 02/18/14/1

02/18/14/2 to 02/25/14/1