
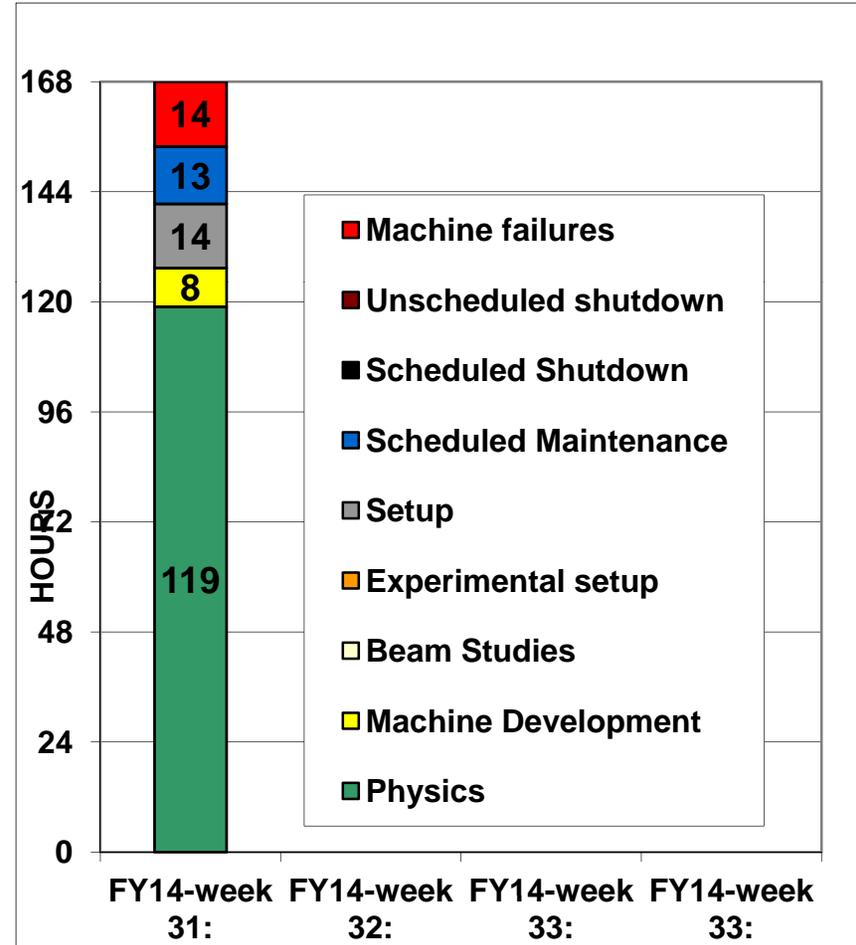


# Availability March- April Run14

last week availability 91% previous week 88%

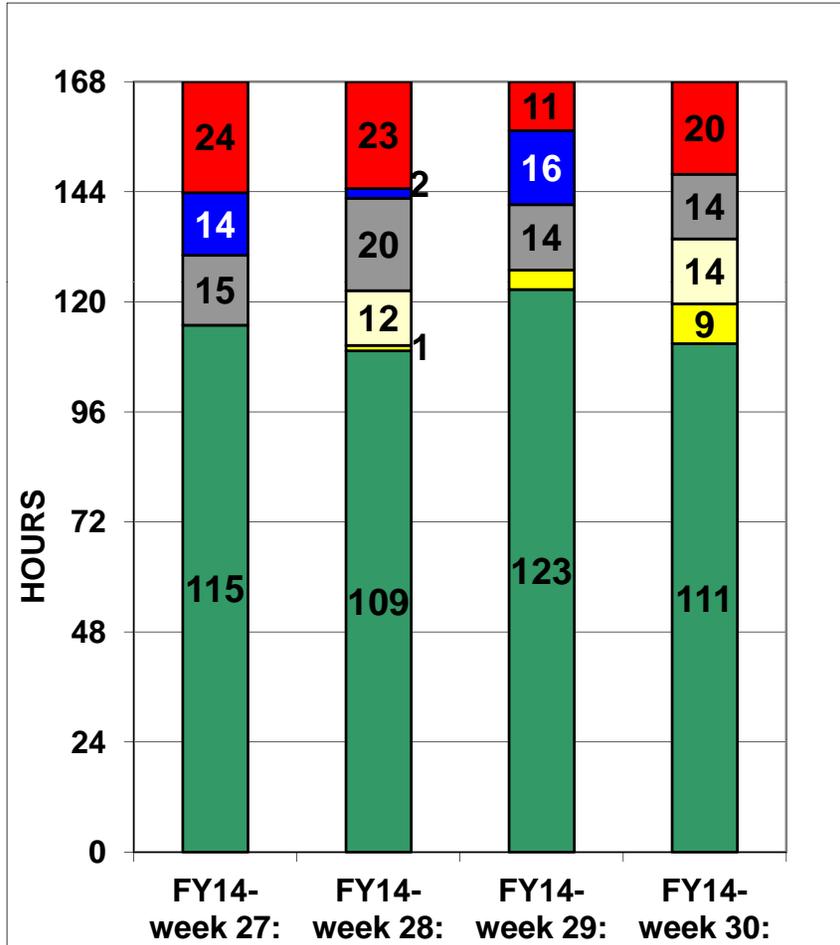

# INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM -- MAY 2014

## Human Error

Blue beam decay rate high after MD

## PS\_AGS (UPS)


UPS in alcove 11B replaced –  
affected access controls

## Rf\_RHIC

56 MHz MPS pulled the permit

## Experiments

STAR pixel detector power supply

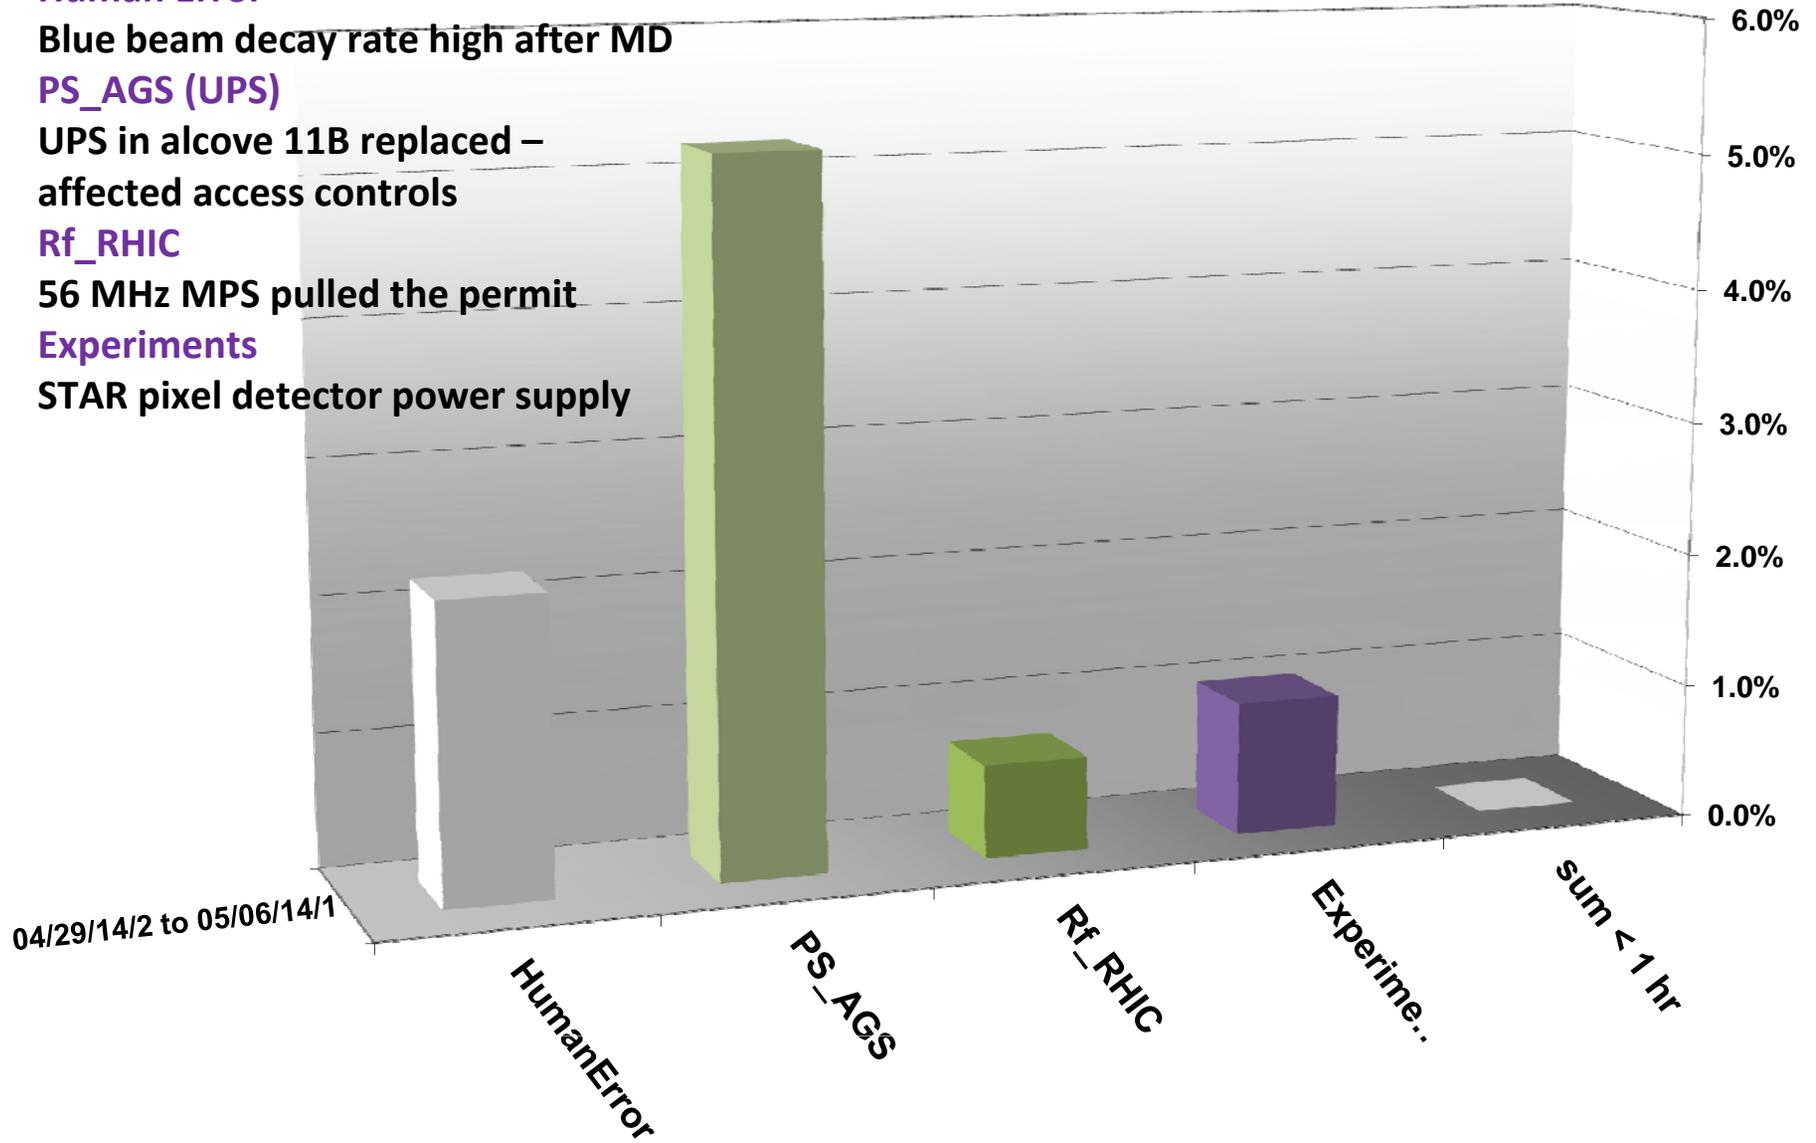

# “Top 10 Failures” : March vs. April

