
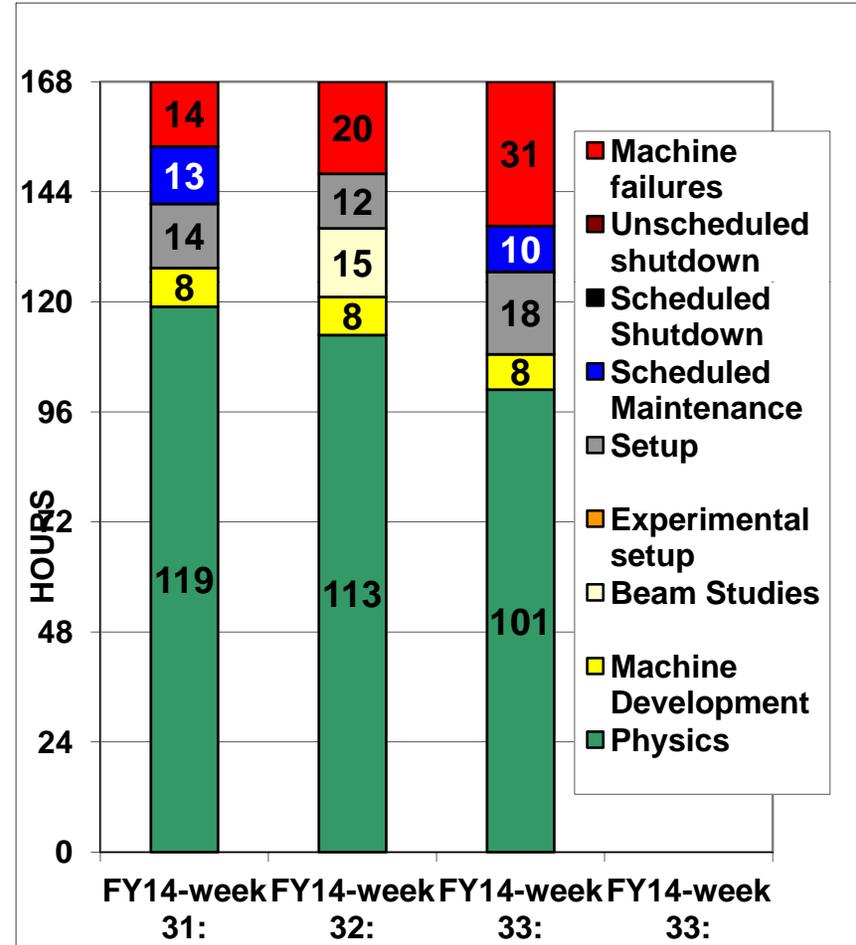


Availability April- May Run14

last week availability 80% previous week 88%

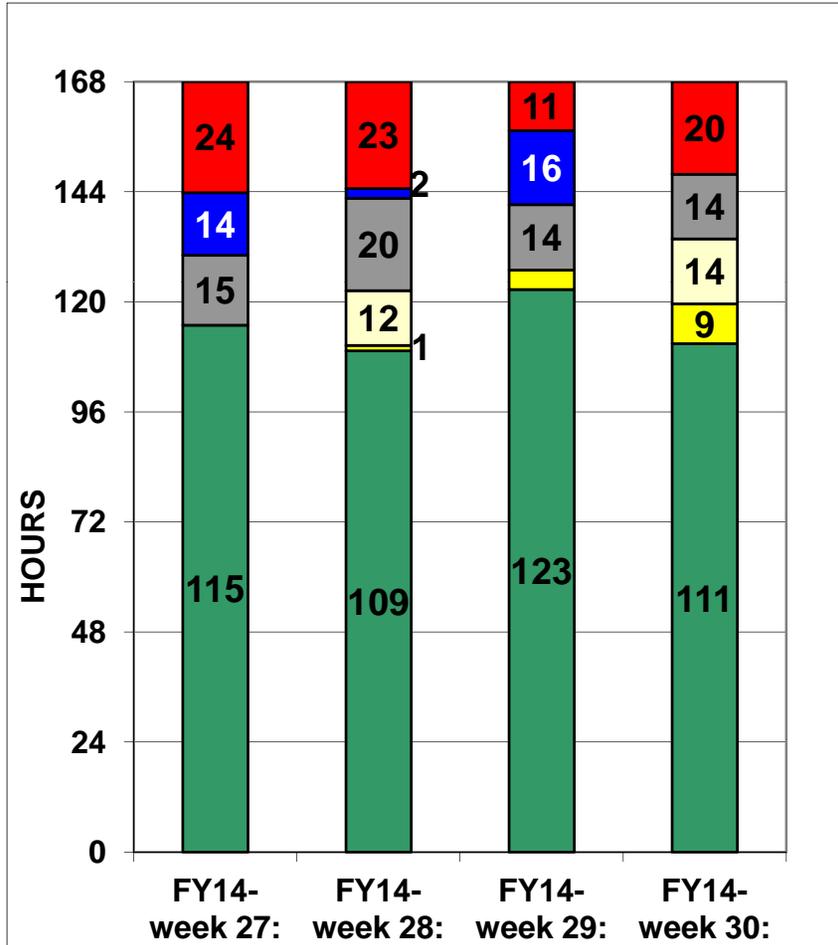

INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM -- MAY 2014

ES&FD_AtR

Wp2-ps off on cooling fault

Rf_RHIC_56MHz

MPS Cryo interlocks

PS_RHIC

Y2-q89ps; tripped, replaced

Y6-q89ps; tripped, replaced

QuenchDetect

11:00 qd fec problems

IceBall

Ice on e-lens magnet leads


ACG_RHIC

7:00 ODH sensor

2:00 gate lost reset – dropped to SA

PPS_RHIC

1B& 2Y Abort kicker pre-fires

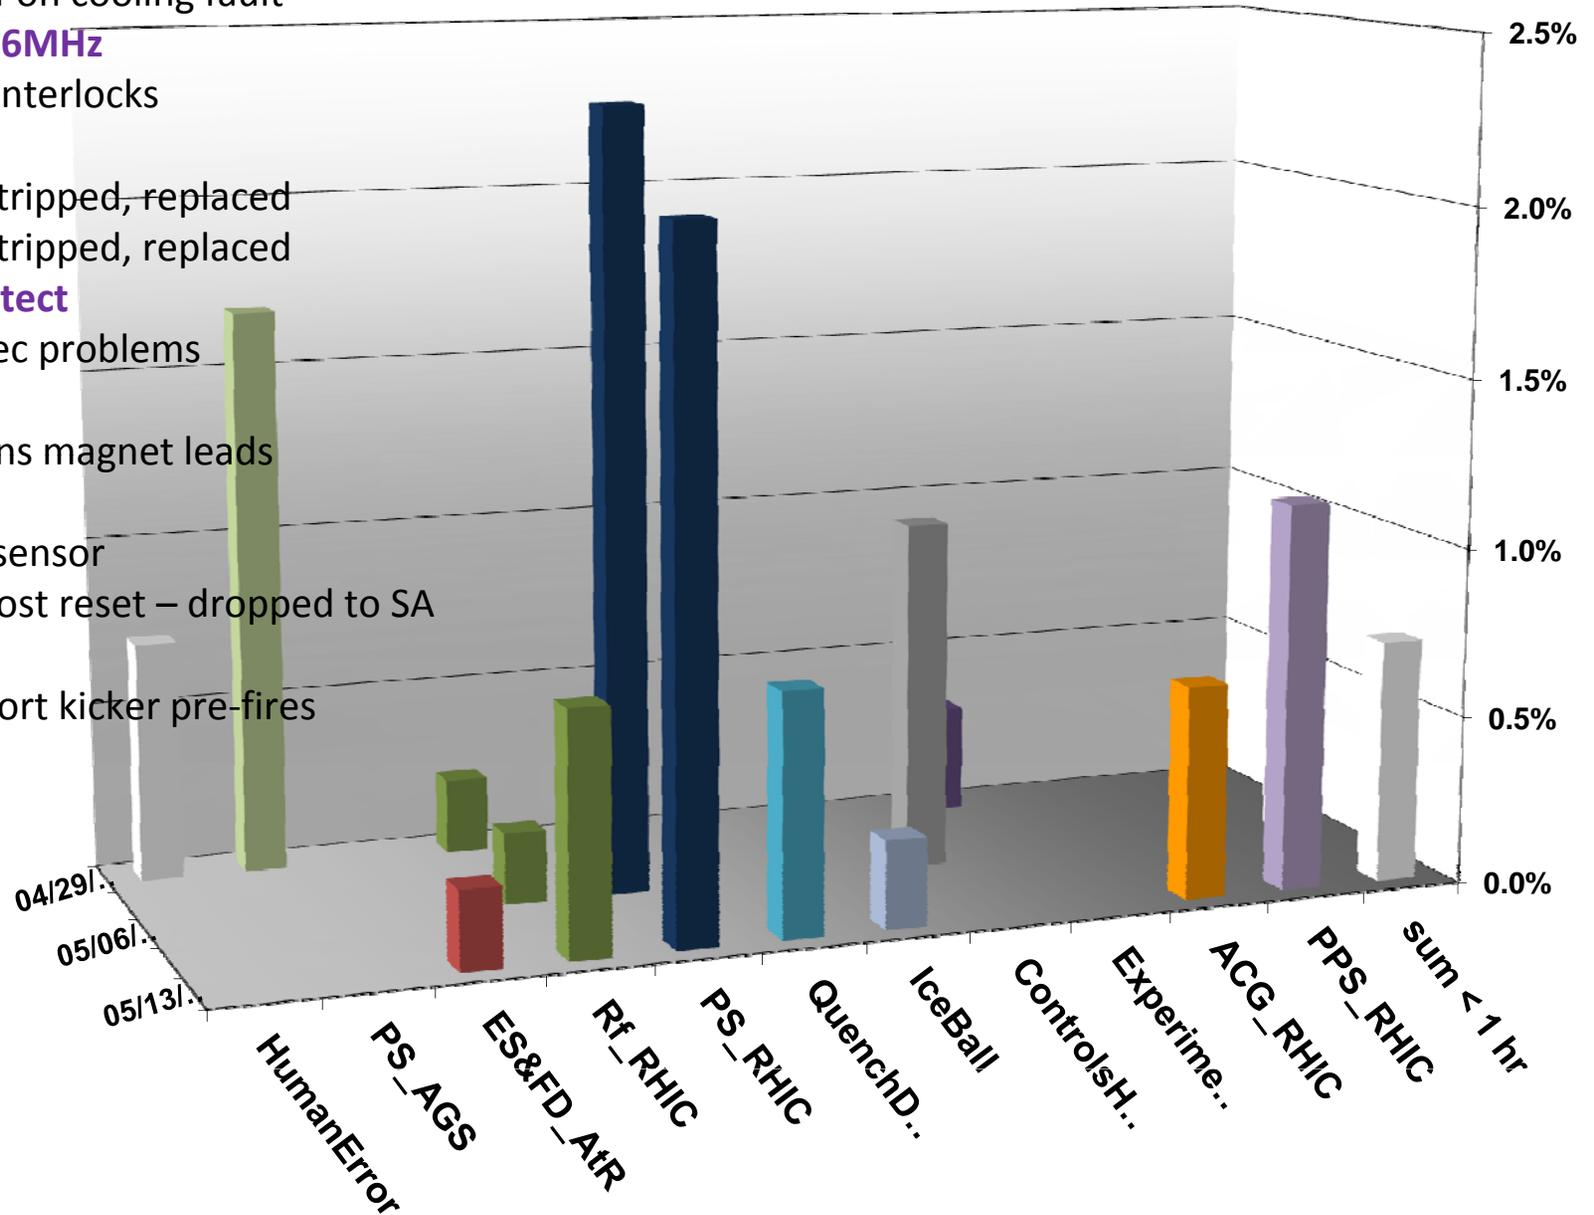

Run14 availability

