
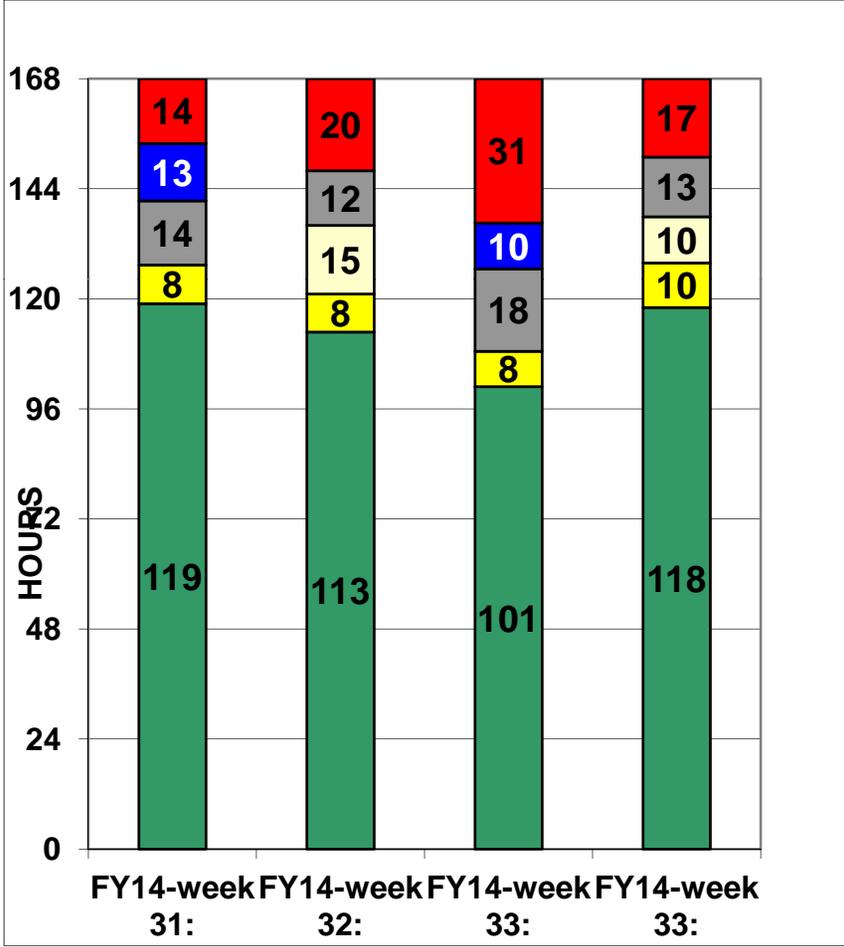


# Availability April- May Run14

last week availability 89% previous week 80%

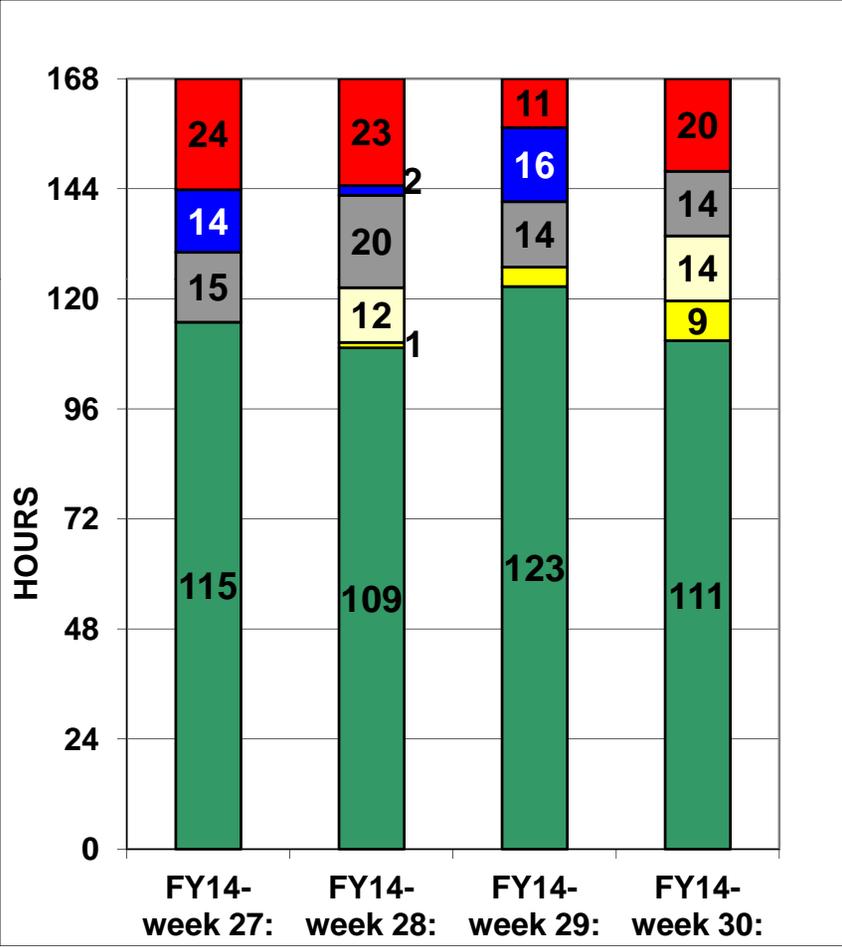

## INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM -- MAY 2014

### Human Error

MD – current too high trained a Dx magnet

### ES&FD\_AtR

Warc20 & wp2 cooling faults

### Rf\_RHIC


Could not turn on Landau cavities

### Quench Protection

Y9-QPSW – shorted capacitor

### PPS\_RHIC

2x Y abort kicker pre-fire

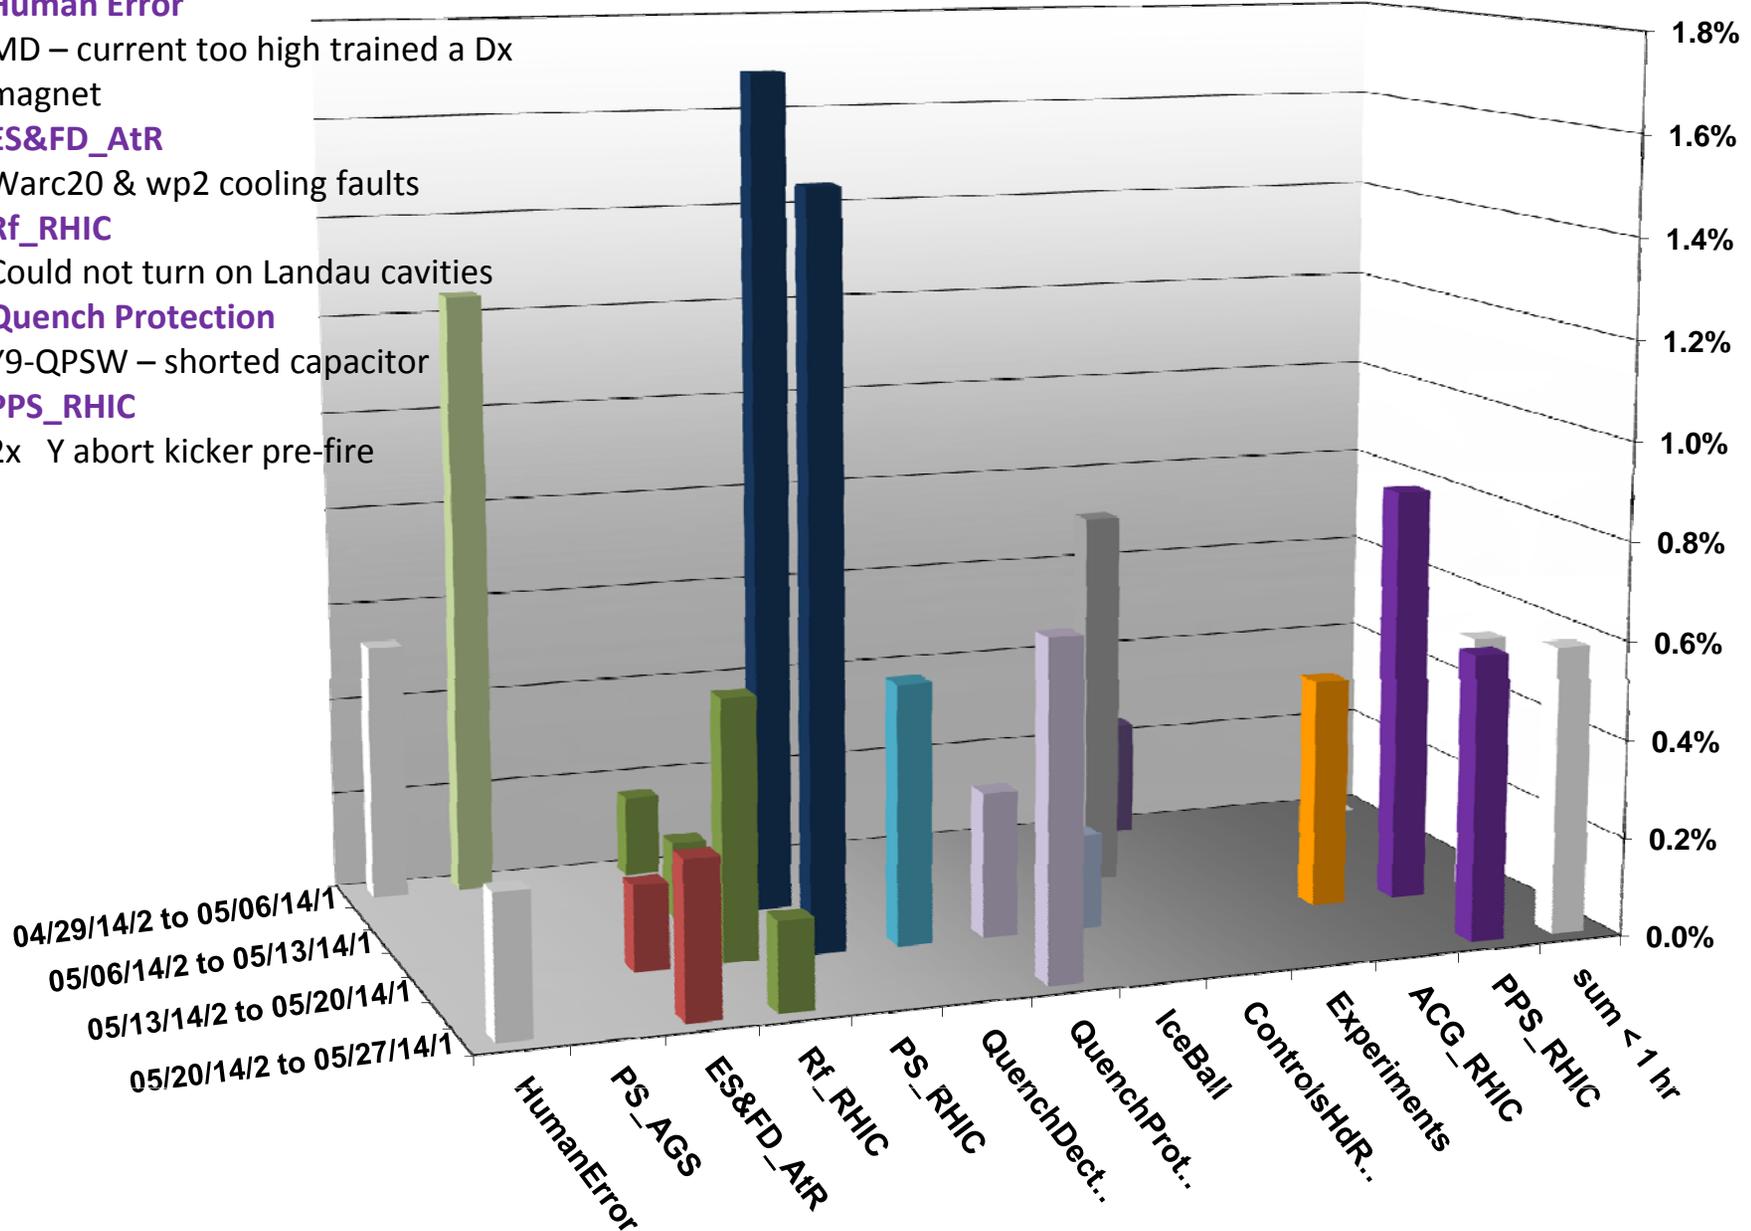

# Run14 availability

