
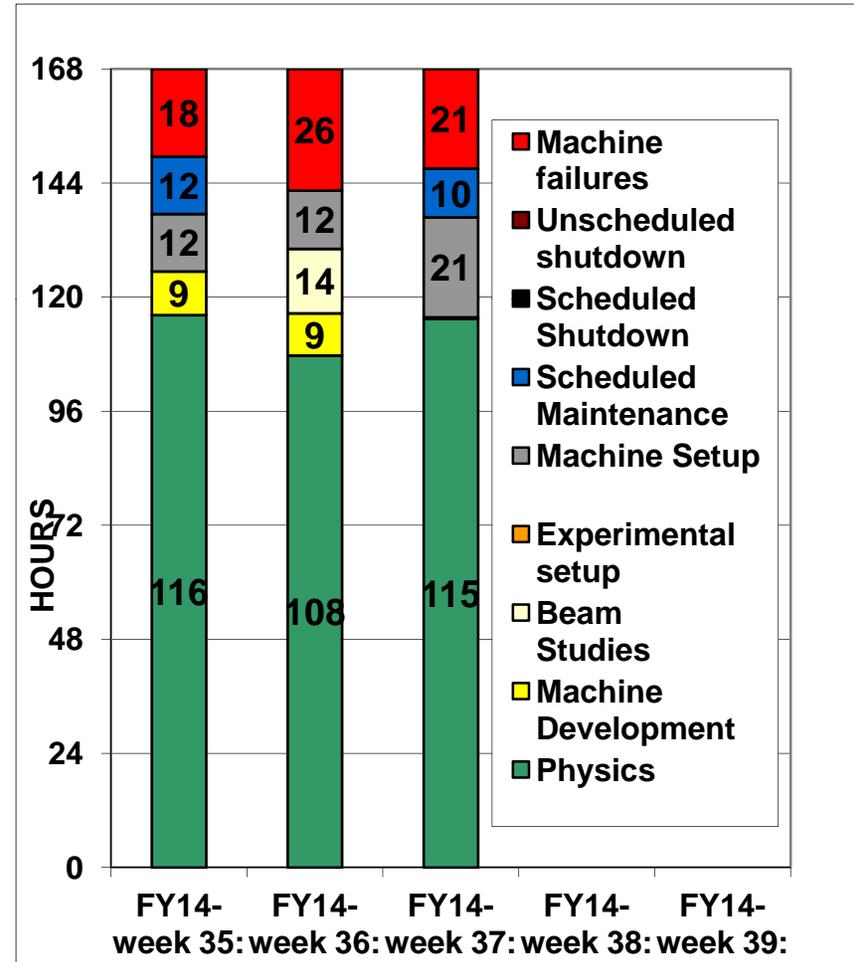


# Availability May- June Run14

last week availability 87% previous week 85%

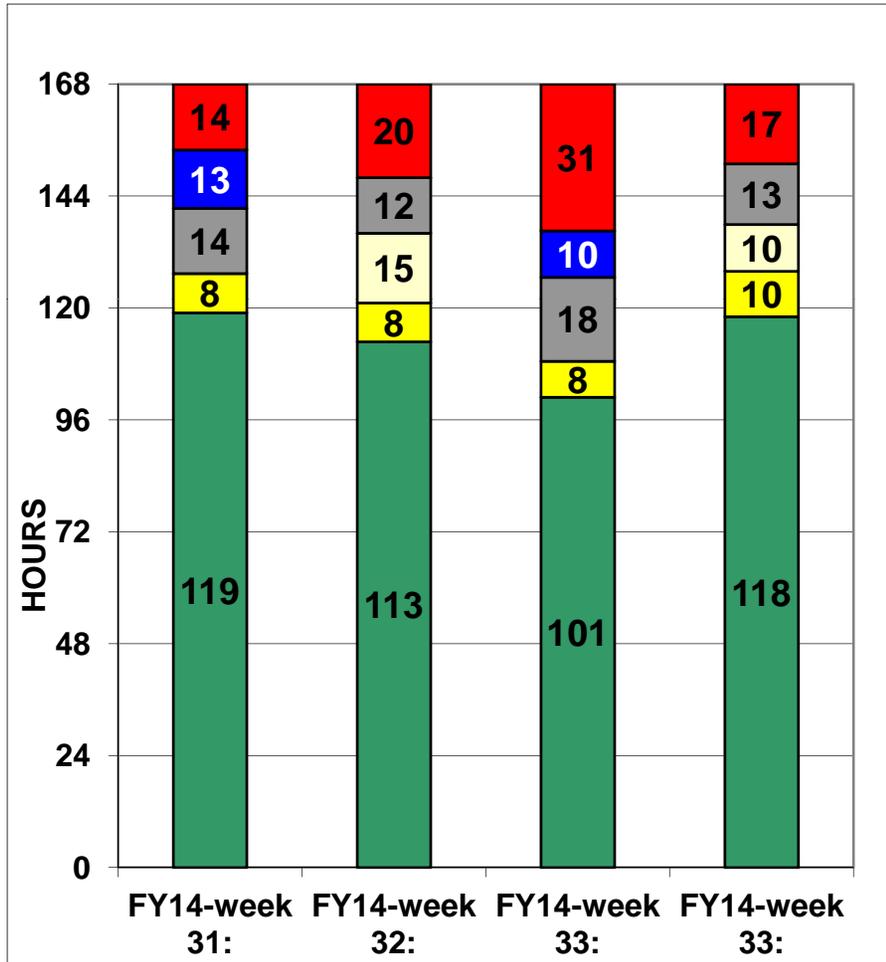

## INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM JUNE 2014

**EBIS**

Missing trigger for LION

**PS\_AGS**

RHIC Alcove 11C UPS

**Experiments**

STAR hadron calorimeter trigger

PHENIX cooling for VTX & other equipment problems

**AtR**

Magnet cooling problems

yq3, yq6, wp2

**RF\_RHIC**


YA1 tuner motor

YA2 PA problem

Yellow landau tripping at transition 3x

**PS\_RHIC**

Gamma Transition supplies tripped after Y landau tripped – took time to recover

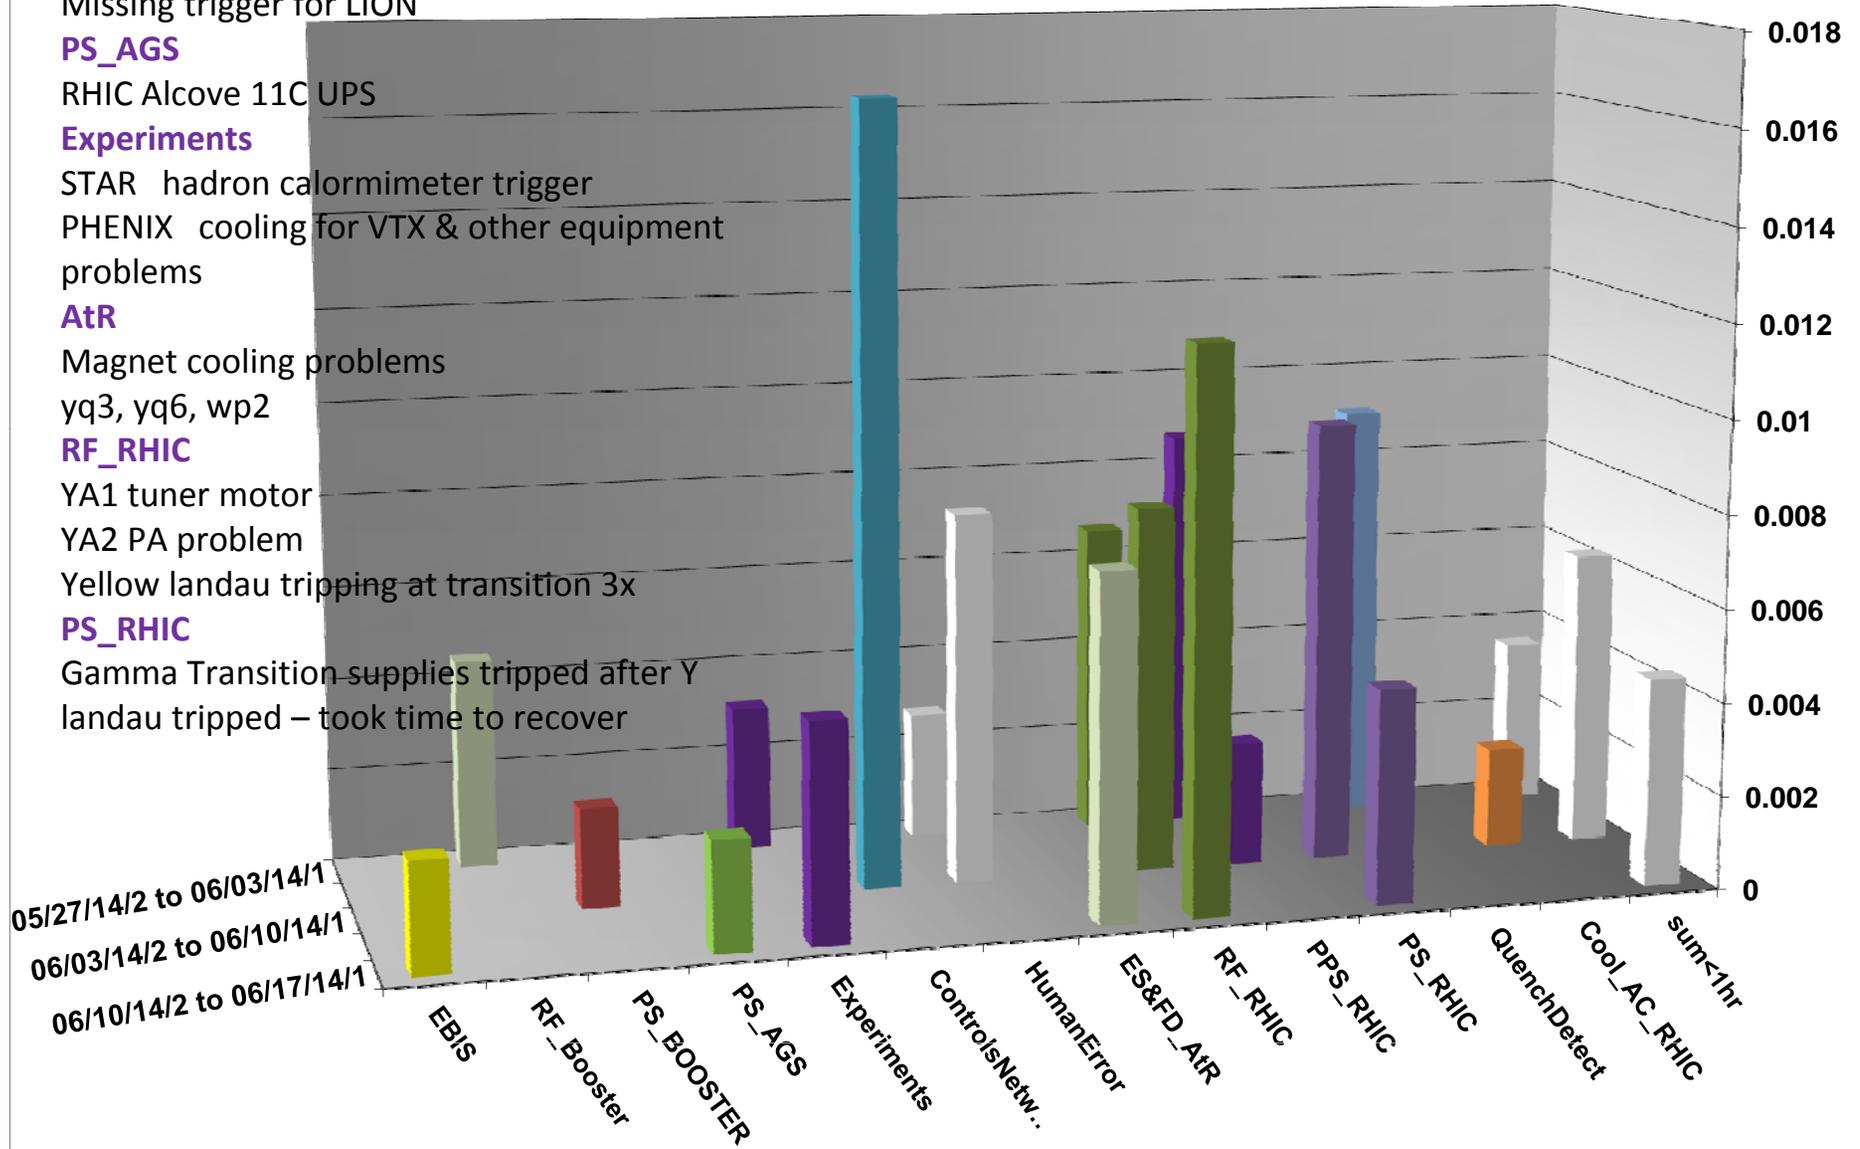

# Run14 availability Q2=86.6%; Q3=87.2%

