Availability May- June Run14

last week availability 93% previous week 87%

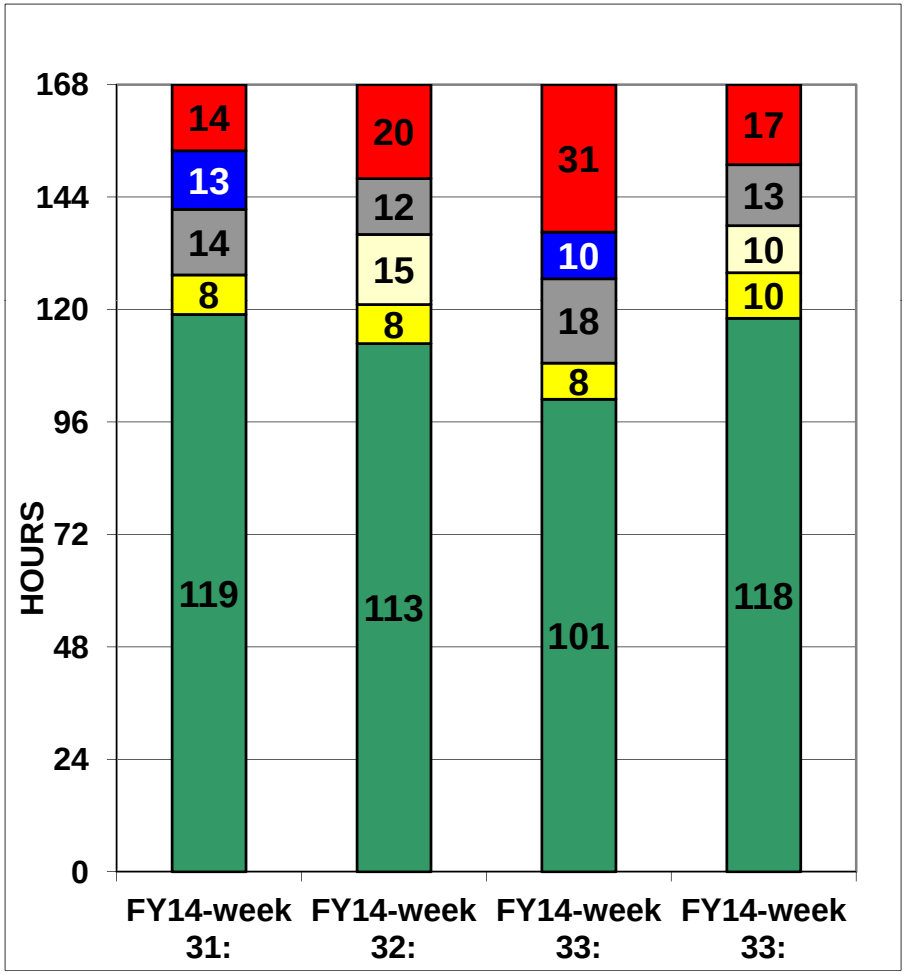

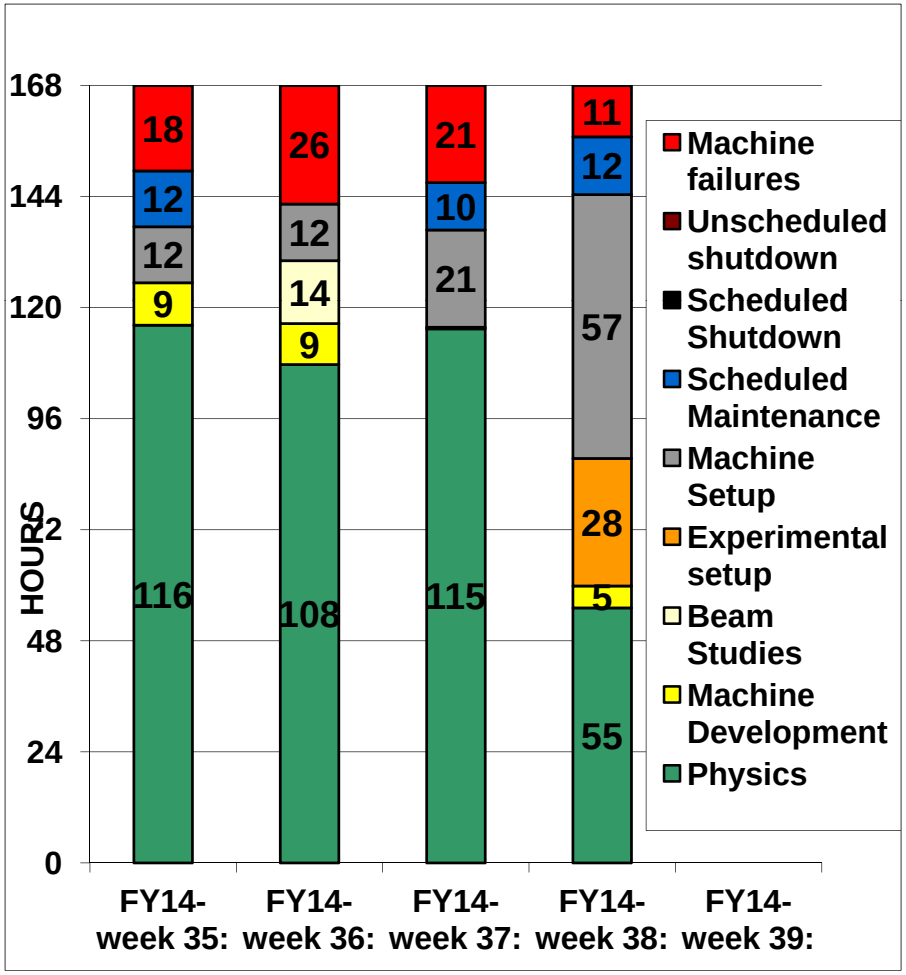

INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM JUNE 2014
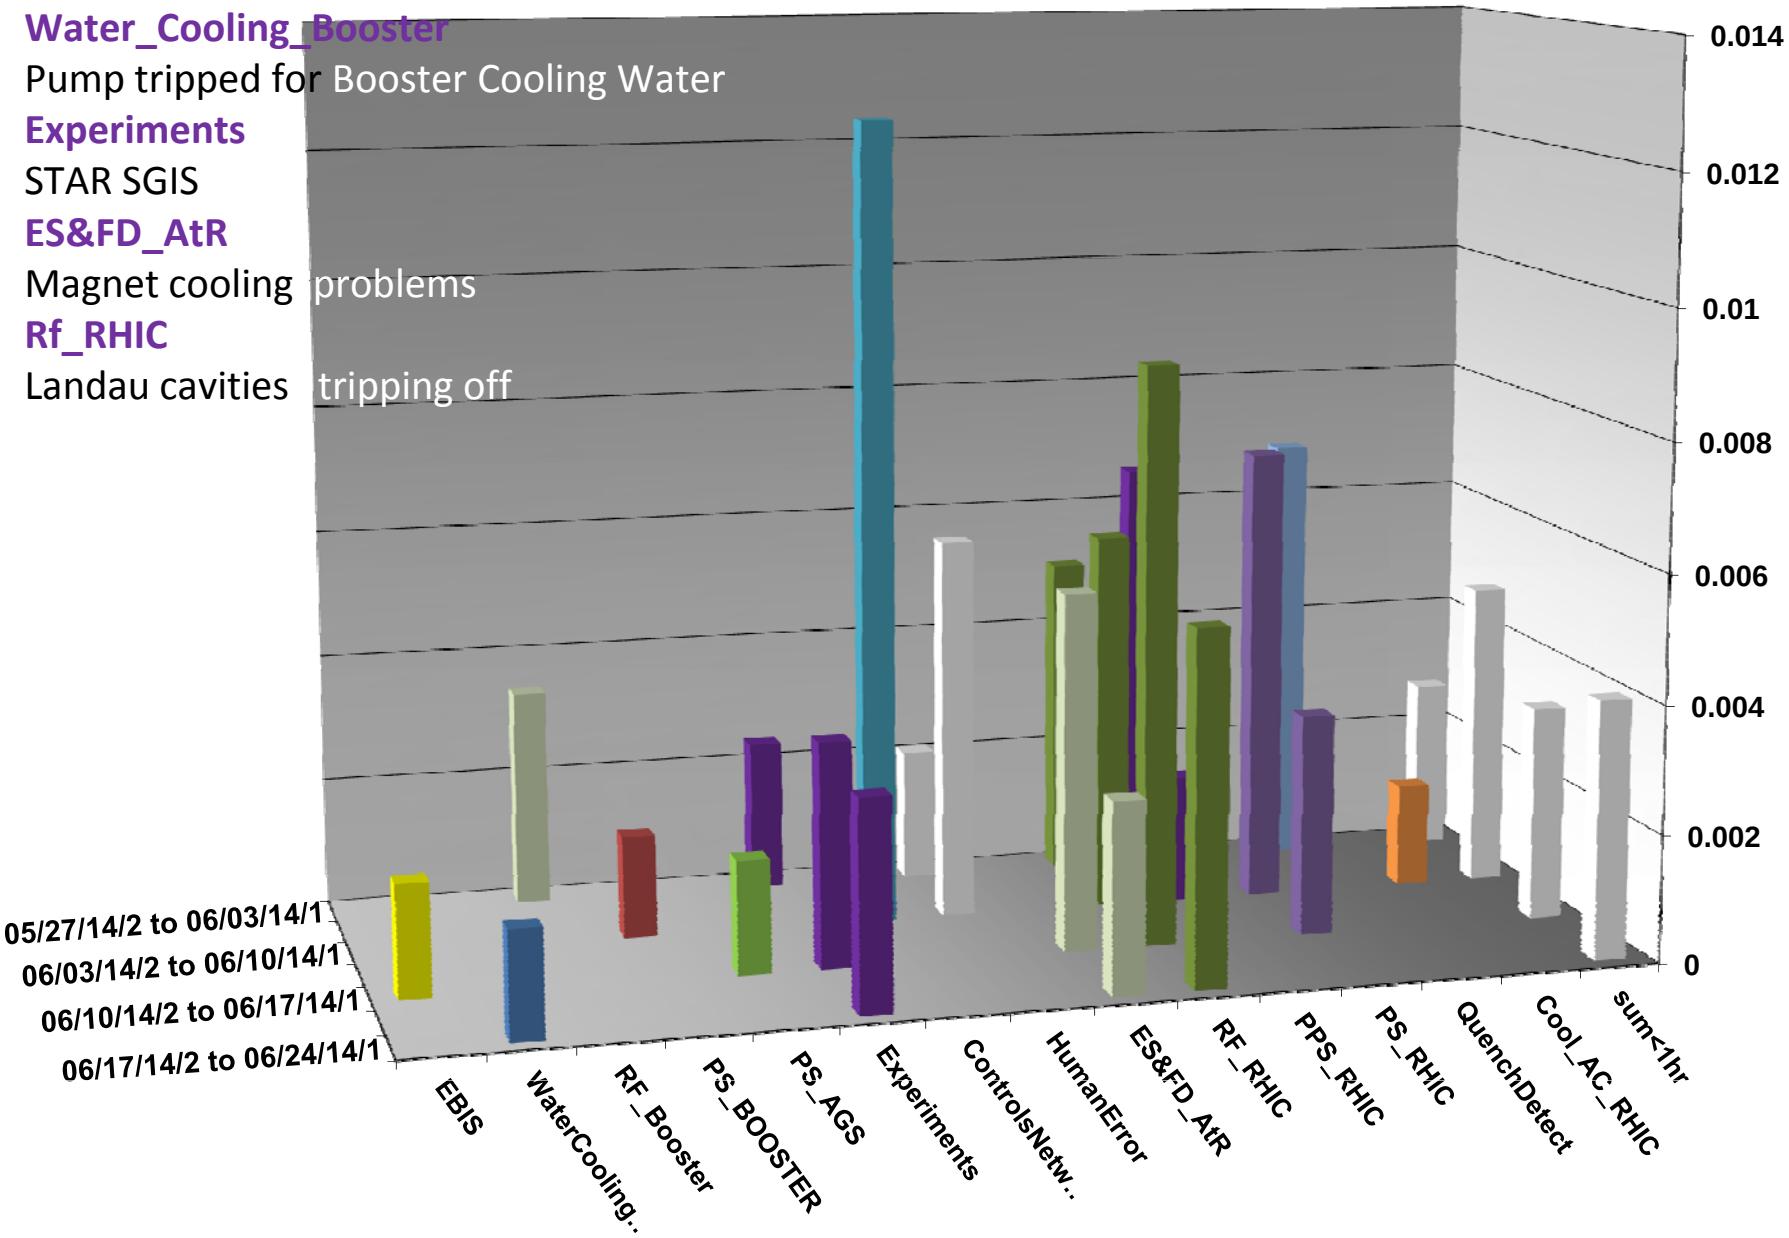
Water_Cooling_Booster
Pump tripped for Booster Cooling Water
Experiments
STAR SGIS
ES&FD_AtR
Magnet cooling problems
Rf_RHIC
Landau cavities tripping off