

INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM MARCH 2015

Electrical Services

Power outage

Rf-AGS – Power Dip Related


B-A synchro – AGS setup

Controls Hardware AGS

cfe-h10 – AGS setup Power Dip related

Cryo – RHIC

Ring Temperature rise – Power Dip related

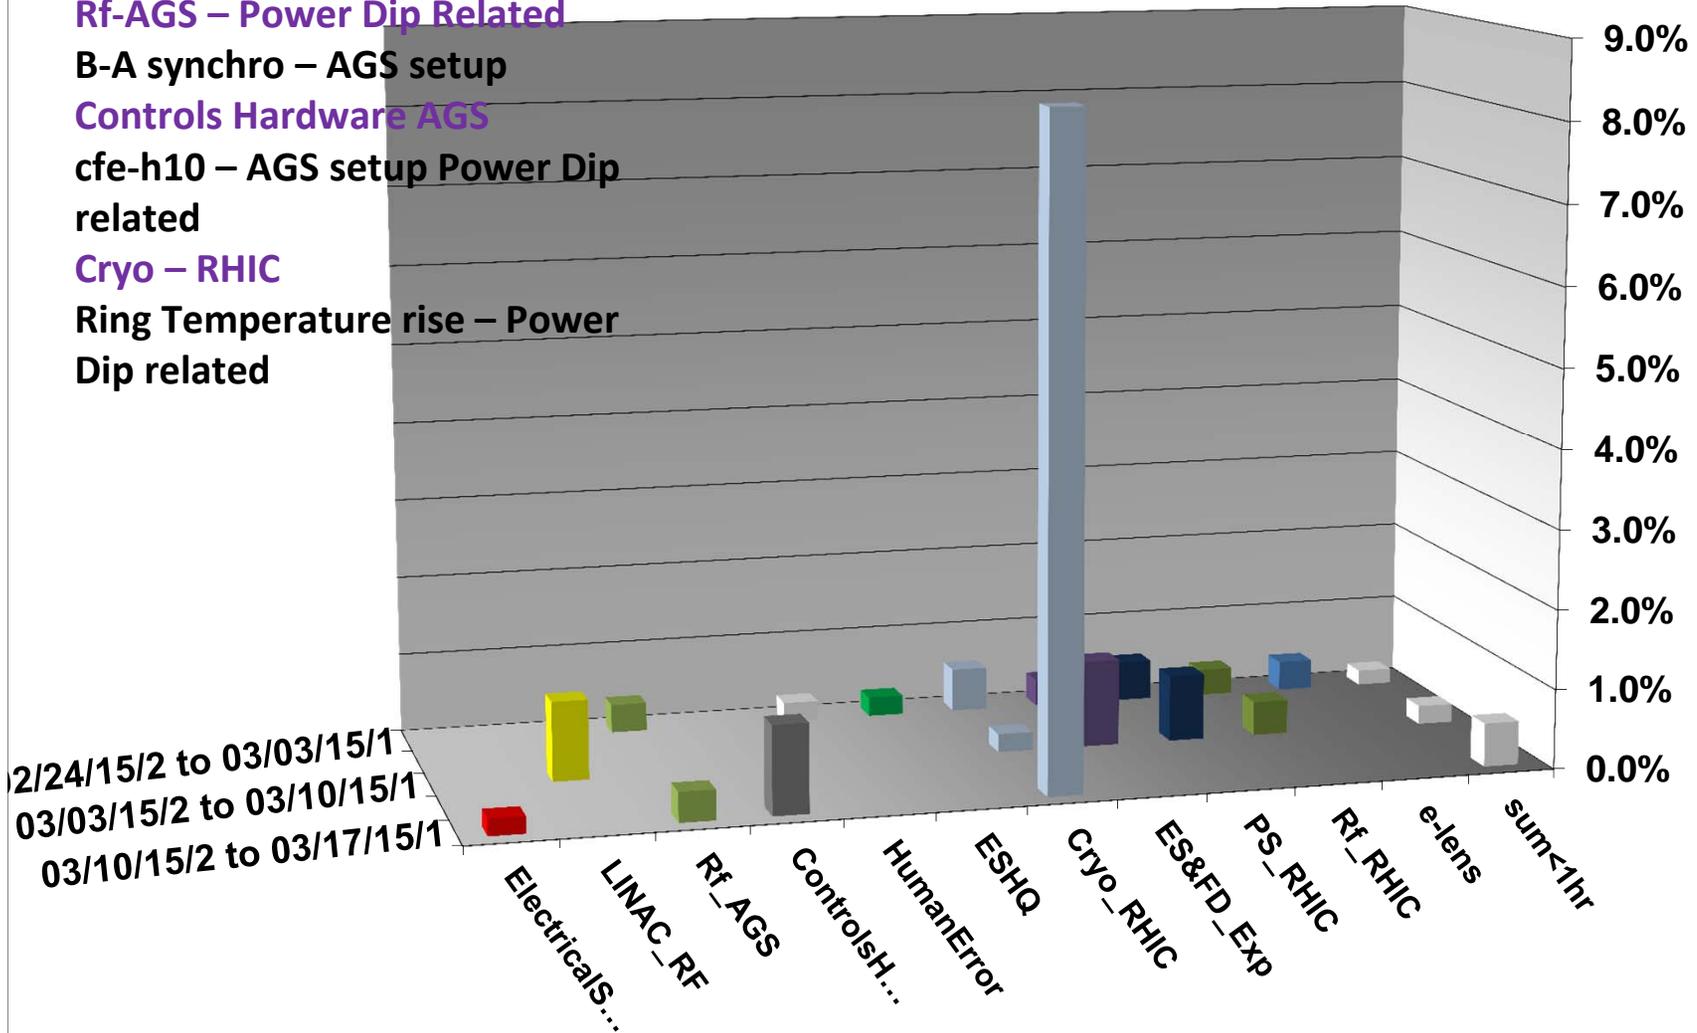

Run15 availability

