


# C-AD ACTIVITY APRIL 2015

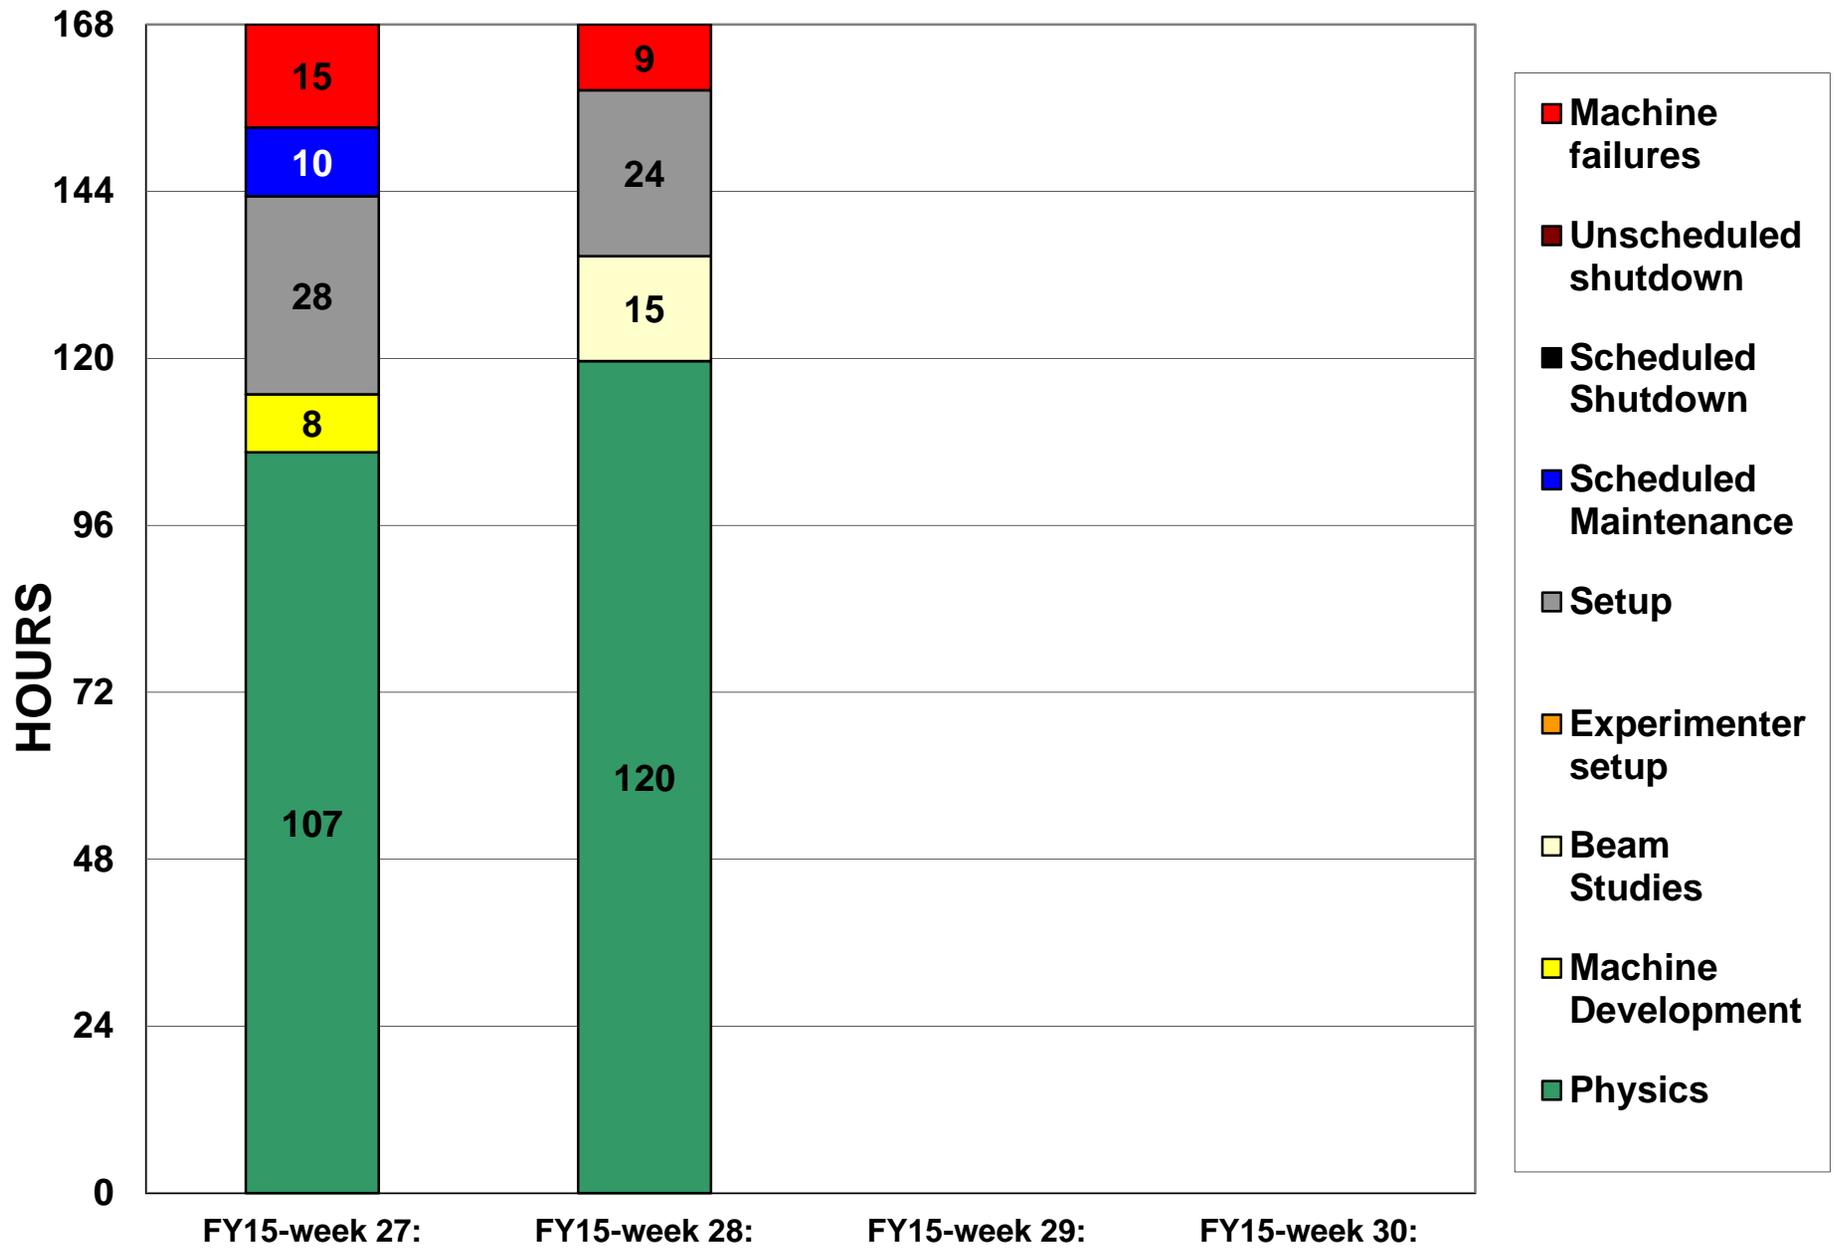

# INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM --APRIL 2015

## CNI Polarimeter Controls

Unable to take Yellow measurements

## BLM Pulls Permit


4X

## INSTRUMENT\_RHIC

12 BPMs – no heartbeat alarm,  
Roman Pot Drives

## SUM OF FAILURES < 1 HR

dominant

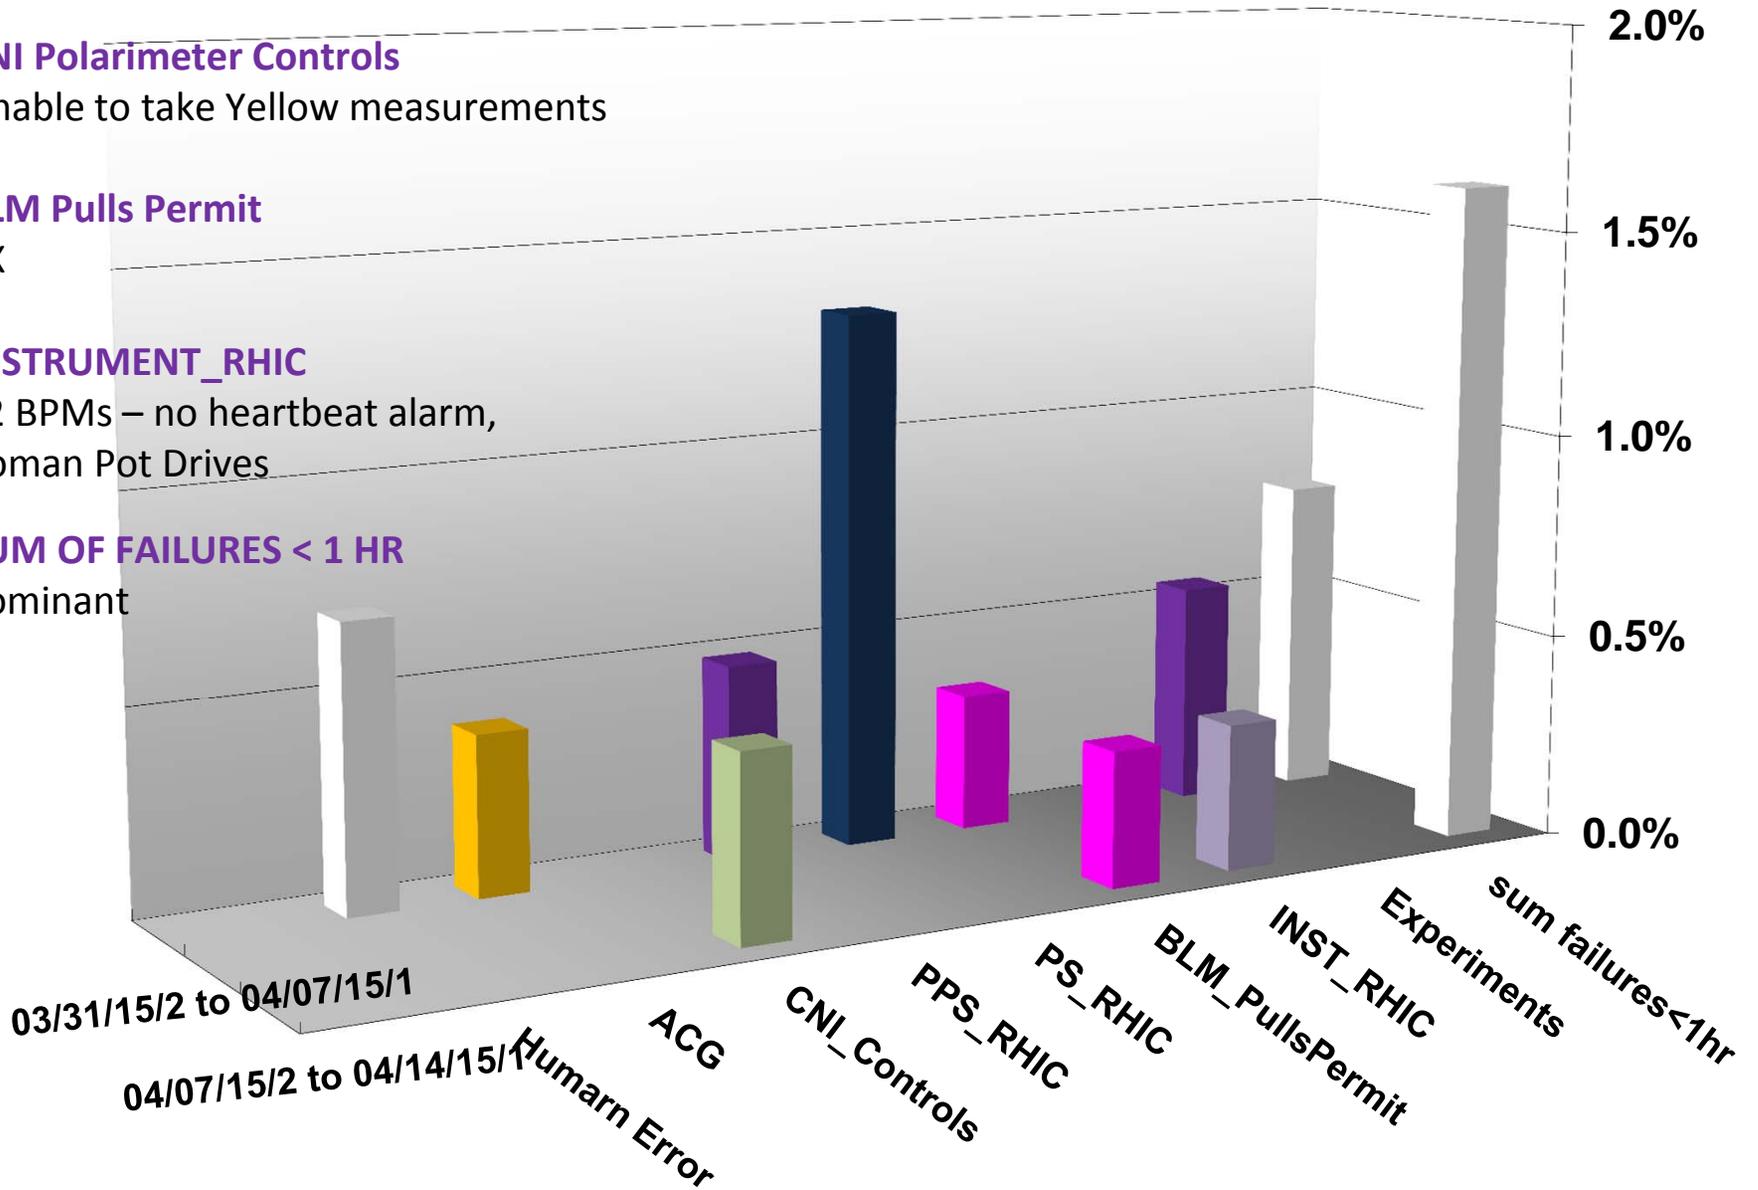

# Run15 availability

