


# C-AD ACTIVITY      FEBRUARY 2016

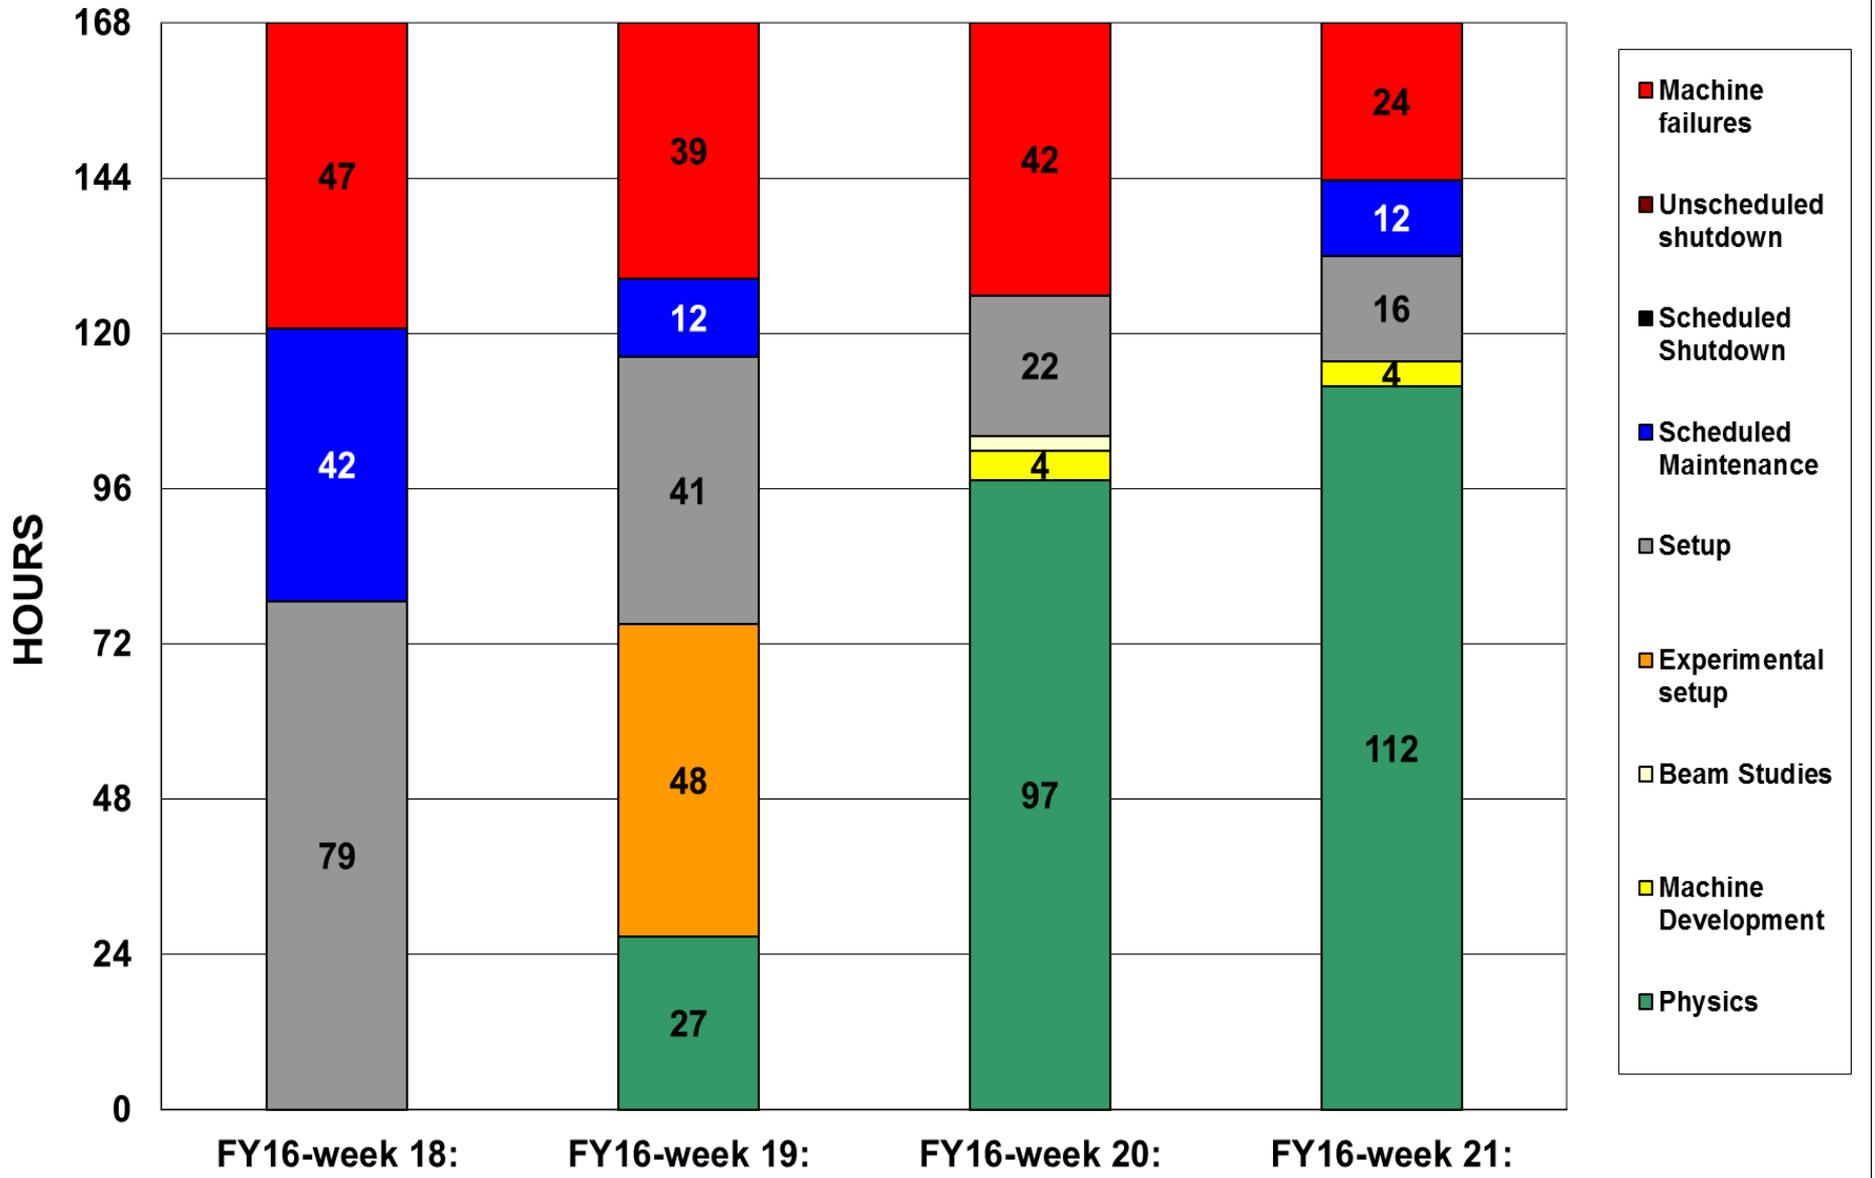

# INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM -- FEBRUARY 2016

## PS\_RHIC

yo8-tq4.ps replaced

q89.ps – could not communicate on restart

## Rf\_RHIC

YA2 power amplifier

## Controls Hardware RHIC

cfe-9b-ps2 reset

9b-ps2 WFG board

## Cryo RHIC

Lead flow controller PS

## UPS

9b-ups1 failed – fecs down

## ELEC RHIC

11C12 Breaker opened – PASS affected

## ACG RHIC

Could not restore IR12 & X/Y arcs after breaker

## Inst\_RHIC

yo8-bh10 bpm – orbit correction takes beams out of collision

## Experiments

Phenix ZDC problem


Communication w/HV mainframe

01/26/16/2 to 02/02/16/1

02/02/16/2 to 02/09/14/16

02/09/16/2 to 02/16/16/1

02/16/16/2 to 02/23/16/1

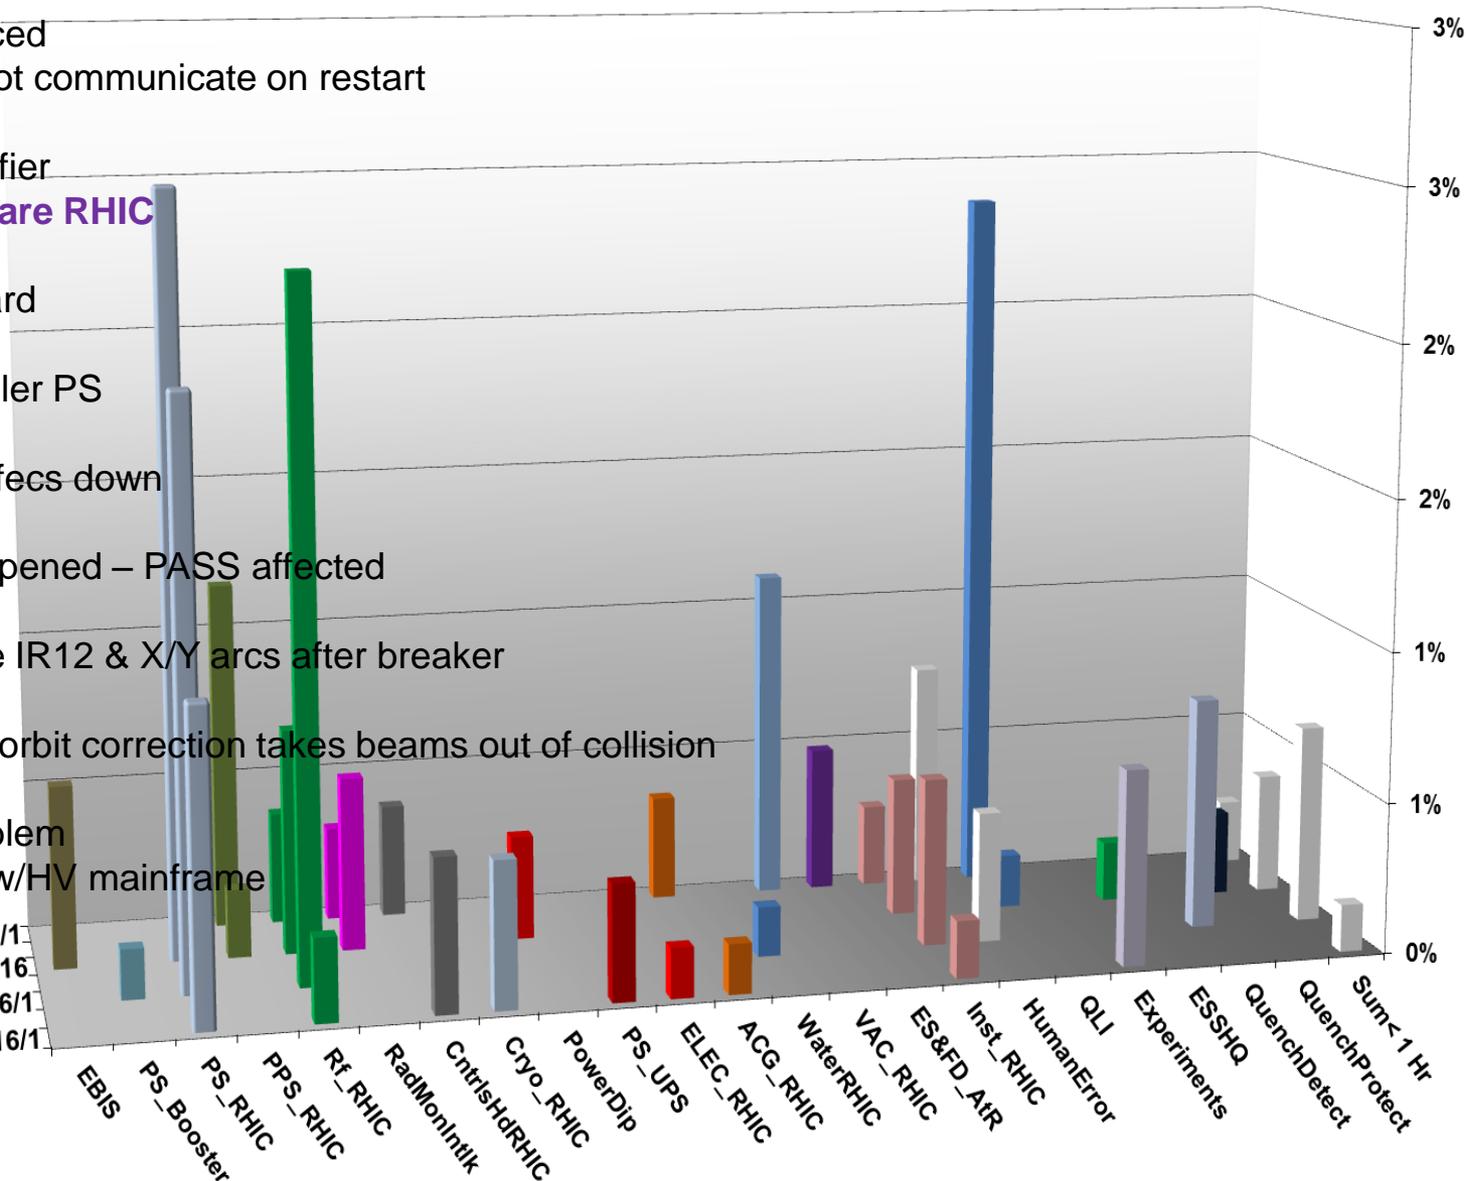

# Run16 availability 79.7%

