C-AD ACTIVITY MAY 2016

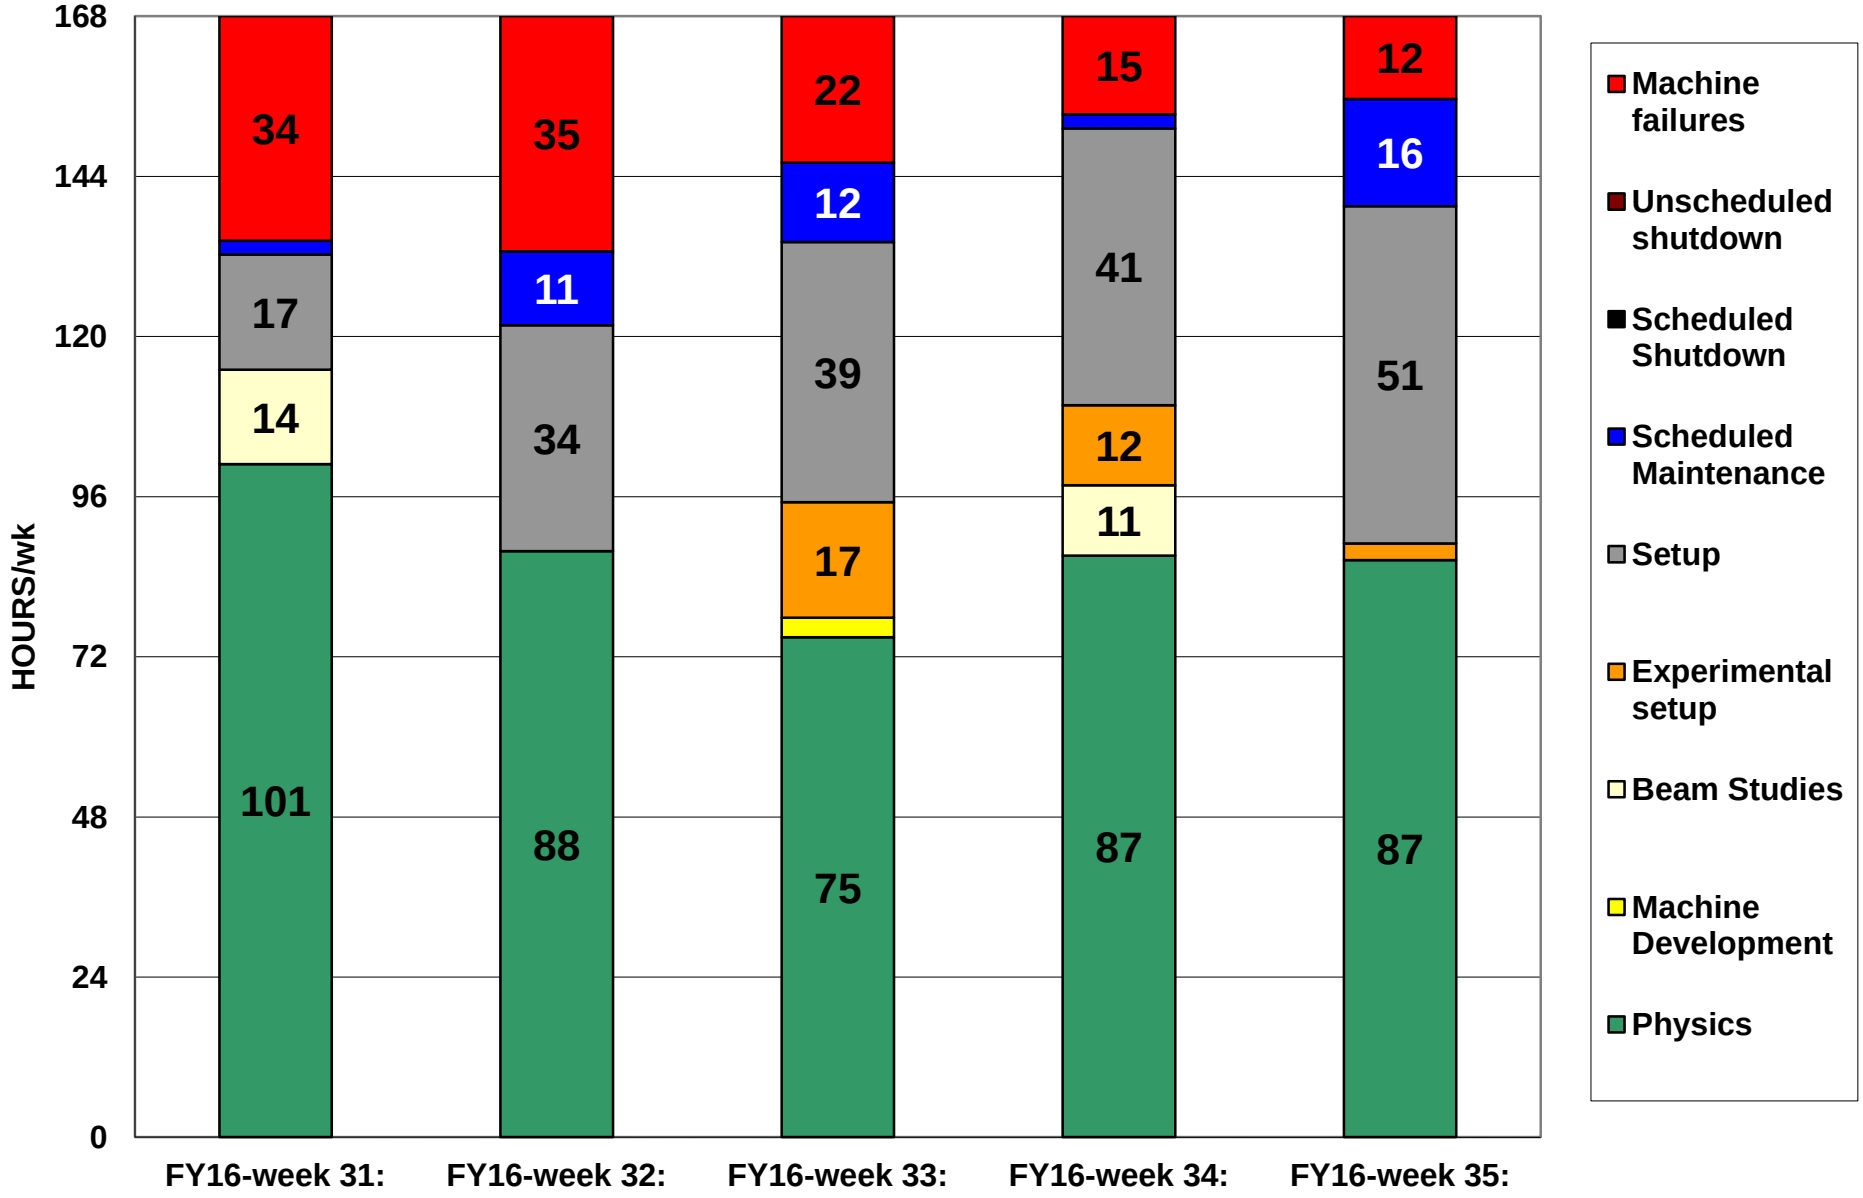

INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM -- MAY 2016

ESHQ
Smoke in IR8 – inergen gas released
PS_RHIC
bi9-qf3 node card replaced
BLM Pulls Permit
9X
Inst_RHIC
Yh BBQ stopped reporting
Fan for BPM module in 5c

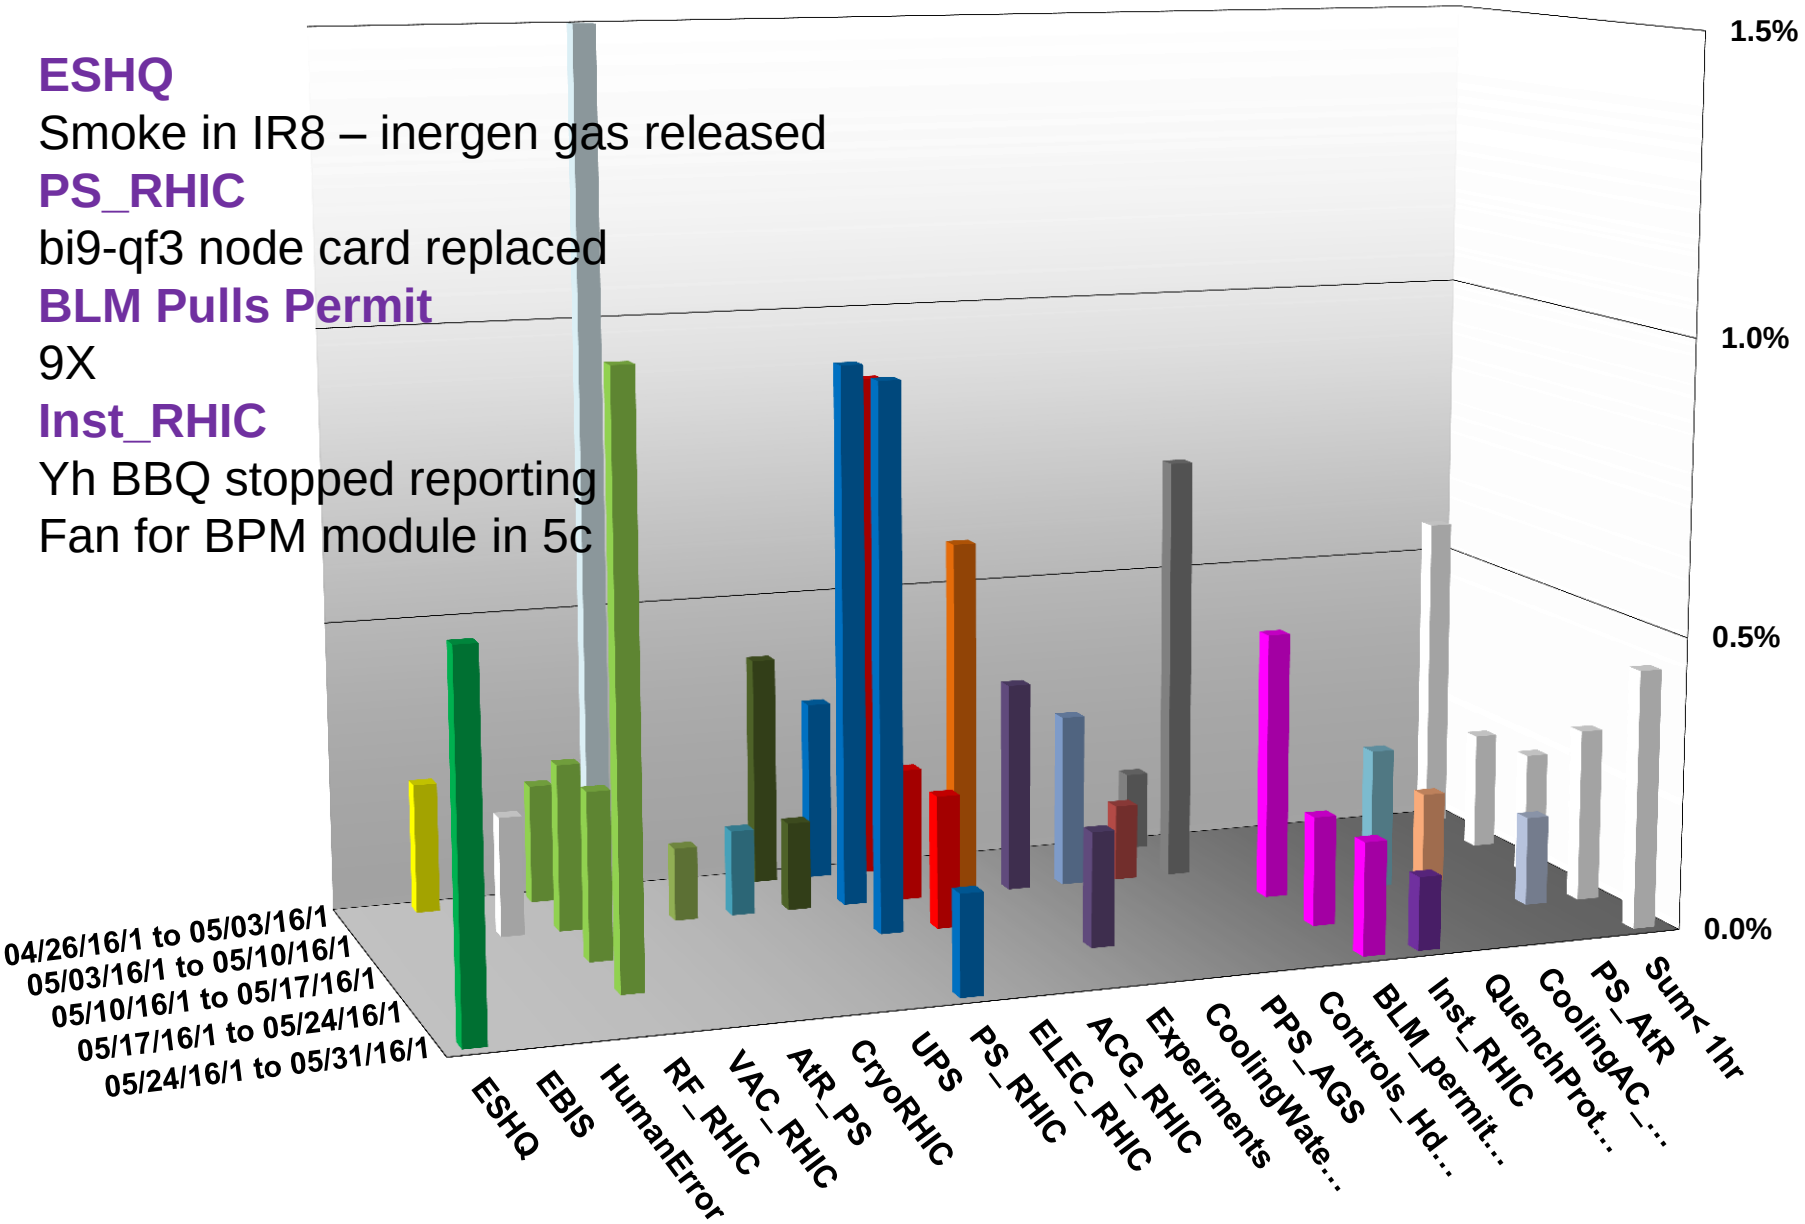
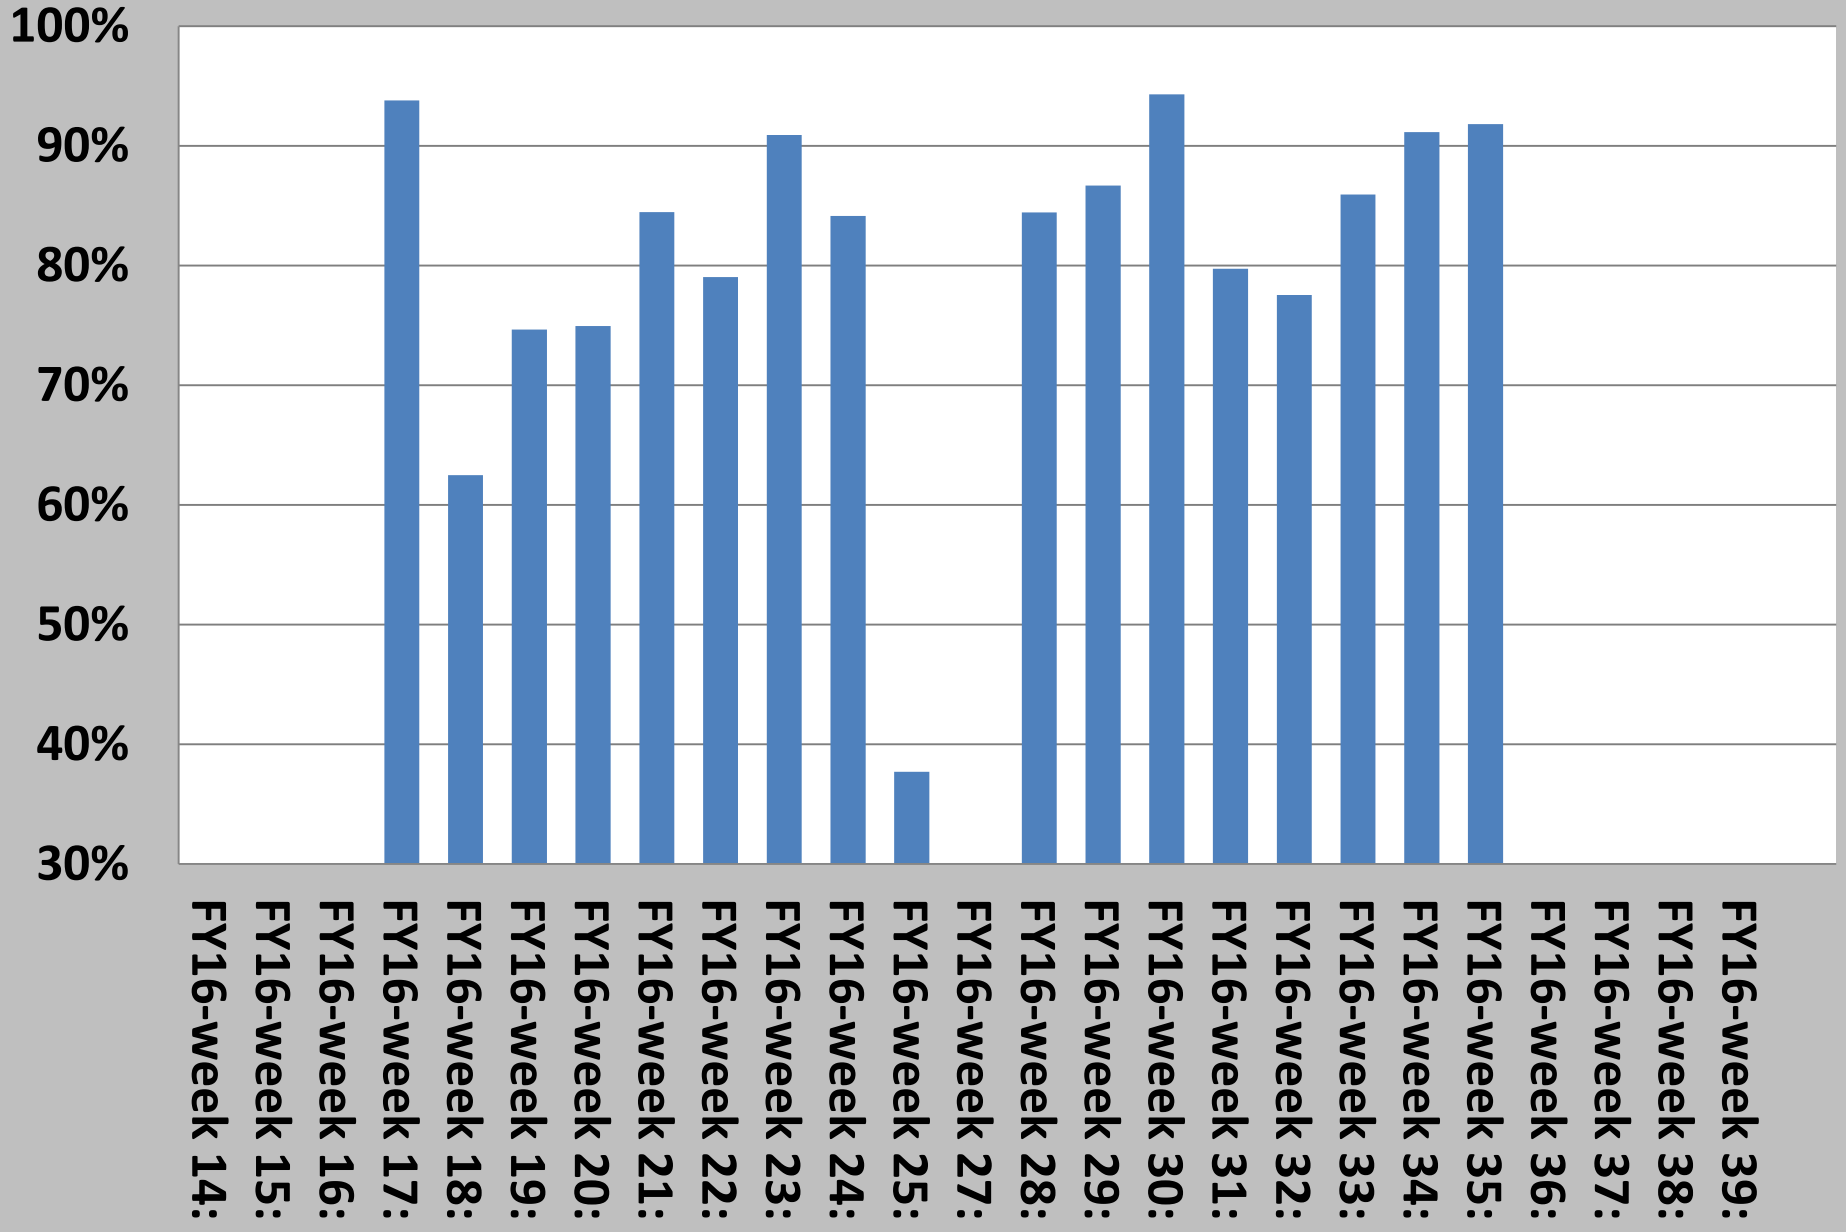
Run16 availability 82%