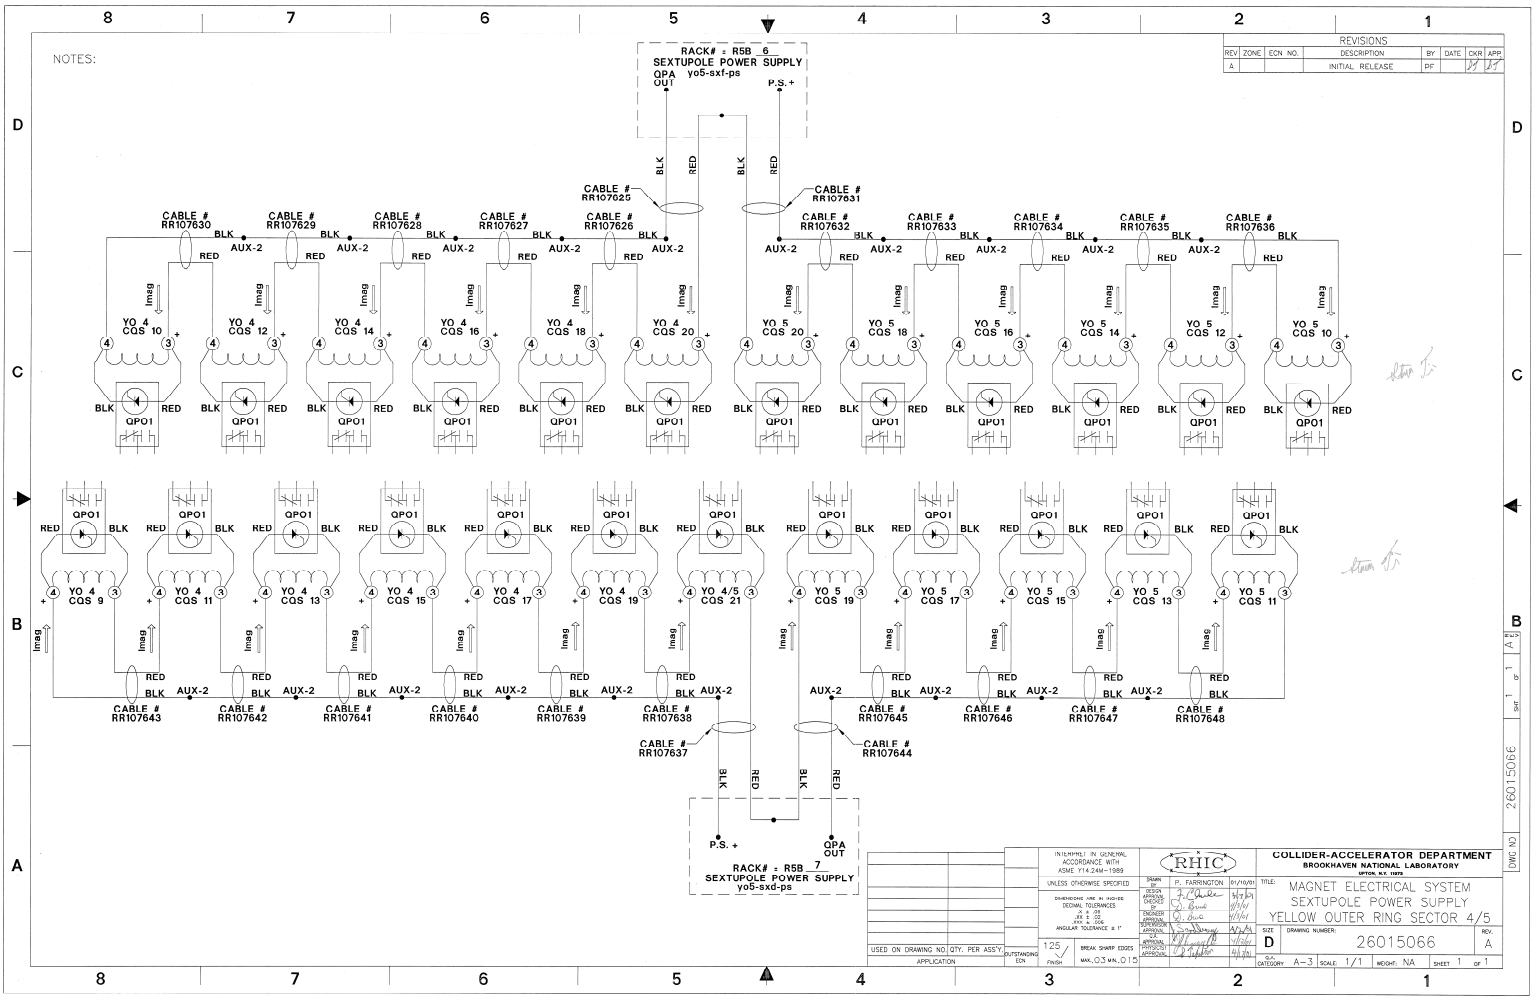
NOTES:
REVISIONS
REV ZONE ECN NO. DESCRIPTION BY DATE CKR APP
A INITIAL RELEASE PF
RACK# = R5B 6
SEXTUPOLE POWER SUPPLY
yo5-sxf-ps
QPA OUT
P.S. +
CABLE # RR107625
CABLE # RR107631
CABLE # RR107630
CABLE # RR107629
CABLE # RR107628
CABLE # RR107627
CABLE # RR107626
CABLE # RR107632
CABLE # RR107633
CABLE # RR107634
CABLE # RR107635
CABLE # RR107636
BLK
RED
AUX-2
Imag
YO 4 CQS 10
YO 4 CQS 12
YO 4 CQS 14
YO 4 CQS 16
YO 4 CQS 18
YO 4 CQS 20
YO 5 CQS 20
YO 5 CQS 18
YO 5 CQS 16
YO 5 CQS 14
YO 5 CQS 12
YO 5 CQS 10
QPO1
YO 4 CQS 9
YO 4 CQS 11
YO 4 CQS 13
YO 4 CQS 15
YO 4 CQS 17
YO 4 CQS 19
YO 4/5 CQS 21
YO 5 CQS 19
YO 5 CQS 17
YO 5 CQS 15
YO 5 CQS 13
YO 5 CQS 11
CABLE # RR107643
CABLE # RR107642
CABLE # RR107641
CABLE # RR107640
CABLE # RR107639
CABLE # RR107638
CABLE # RR107645
CABLE # RR107646
CABLE # RR107647
CABLE # RR107648
CABLE # RR107637
CABLE # RR107644
RACK# = R5B 7
SEXTUPOLE POWER SUPPLY
yo5-sxd-ps
INTERPRET IN GENERAL ACCORDANCE WITH ASME Y14.24M-1989
UNLESS OTHERWISE SPECIFIED
DIMENSIONS ARE IN INCHES
DECIMAL TOLERANCES
ANGULAR TOLERANCE ± 1°
USED ON DRAWING NO. QTY. PER ASS'Y.
APPLICATION
OUTSTANDING EDN
125
FINISH
BREAK SHARP EDGES
MAX. .03 MIN. .015
RHIC
DRAWN BY P. FARRINGTON 01/10/01
DESIGN APPROVAL
CHECKED BY
ENGINEER APPROVAL
SUPERVISOR APPROVAL
PHYSICIST APPROVAL
COLLIDER-ACCELERATOR DEPARTMENT
BROOKHAVEN NATIONAL LABORATORY
UPTON, N.Y. 11973
TITLE: MAGNET ELECTRICAL SYSTEM
SEXTUPOLE POWER SUPPLY
YELLOW OUTER RING SECTOR 4/5
SIZE D
DRAWING NUMBER: 26015066
REV. A
Q.A. CATEGORY A-3
SCALE: 1/1
WEIGHT: NA
SHEET 1 OF 1
DWG NO 26015066
SHT 1 OF 1
REV A