
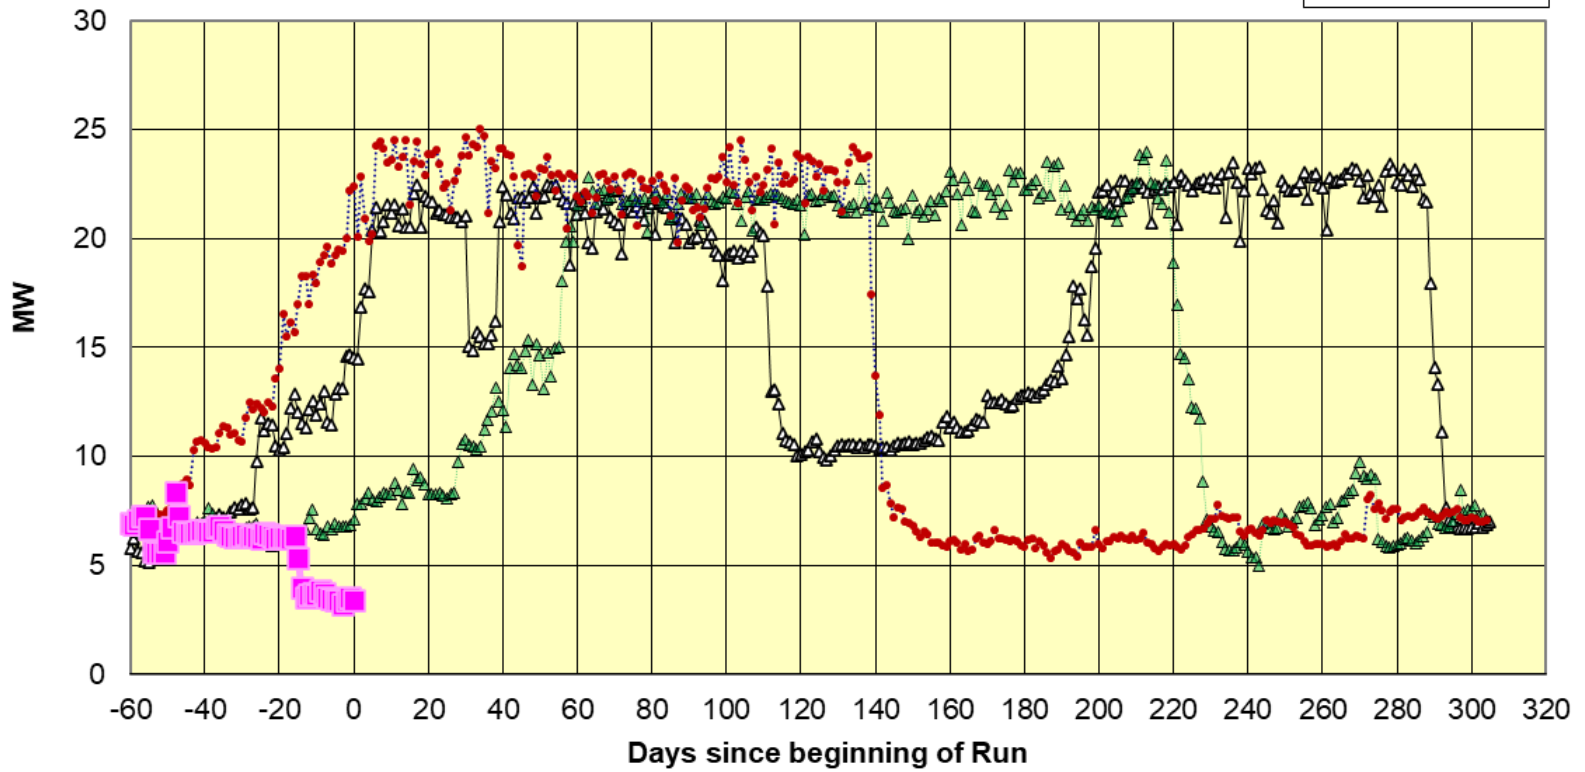




as of 30 November 2022

RHIC Operations FY20-23




as of 30 November 2022

RHIC Cryo Operations FY20-23

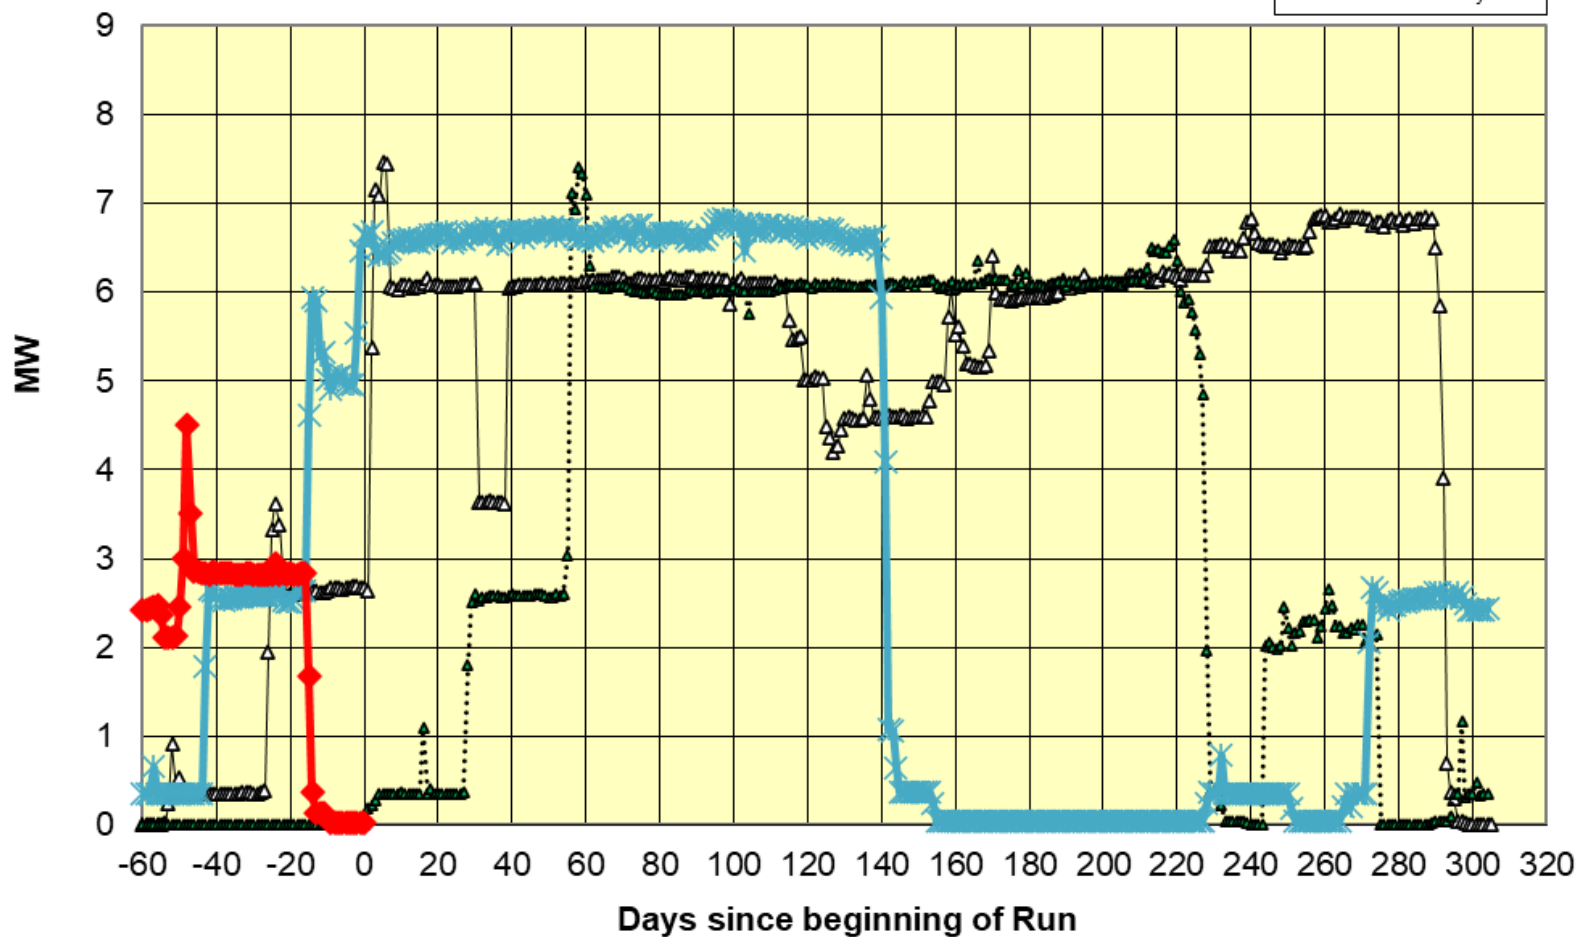


as of 30 November 2022

C-AD Energy Use FY 2002-23

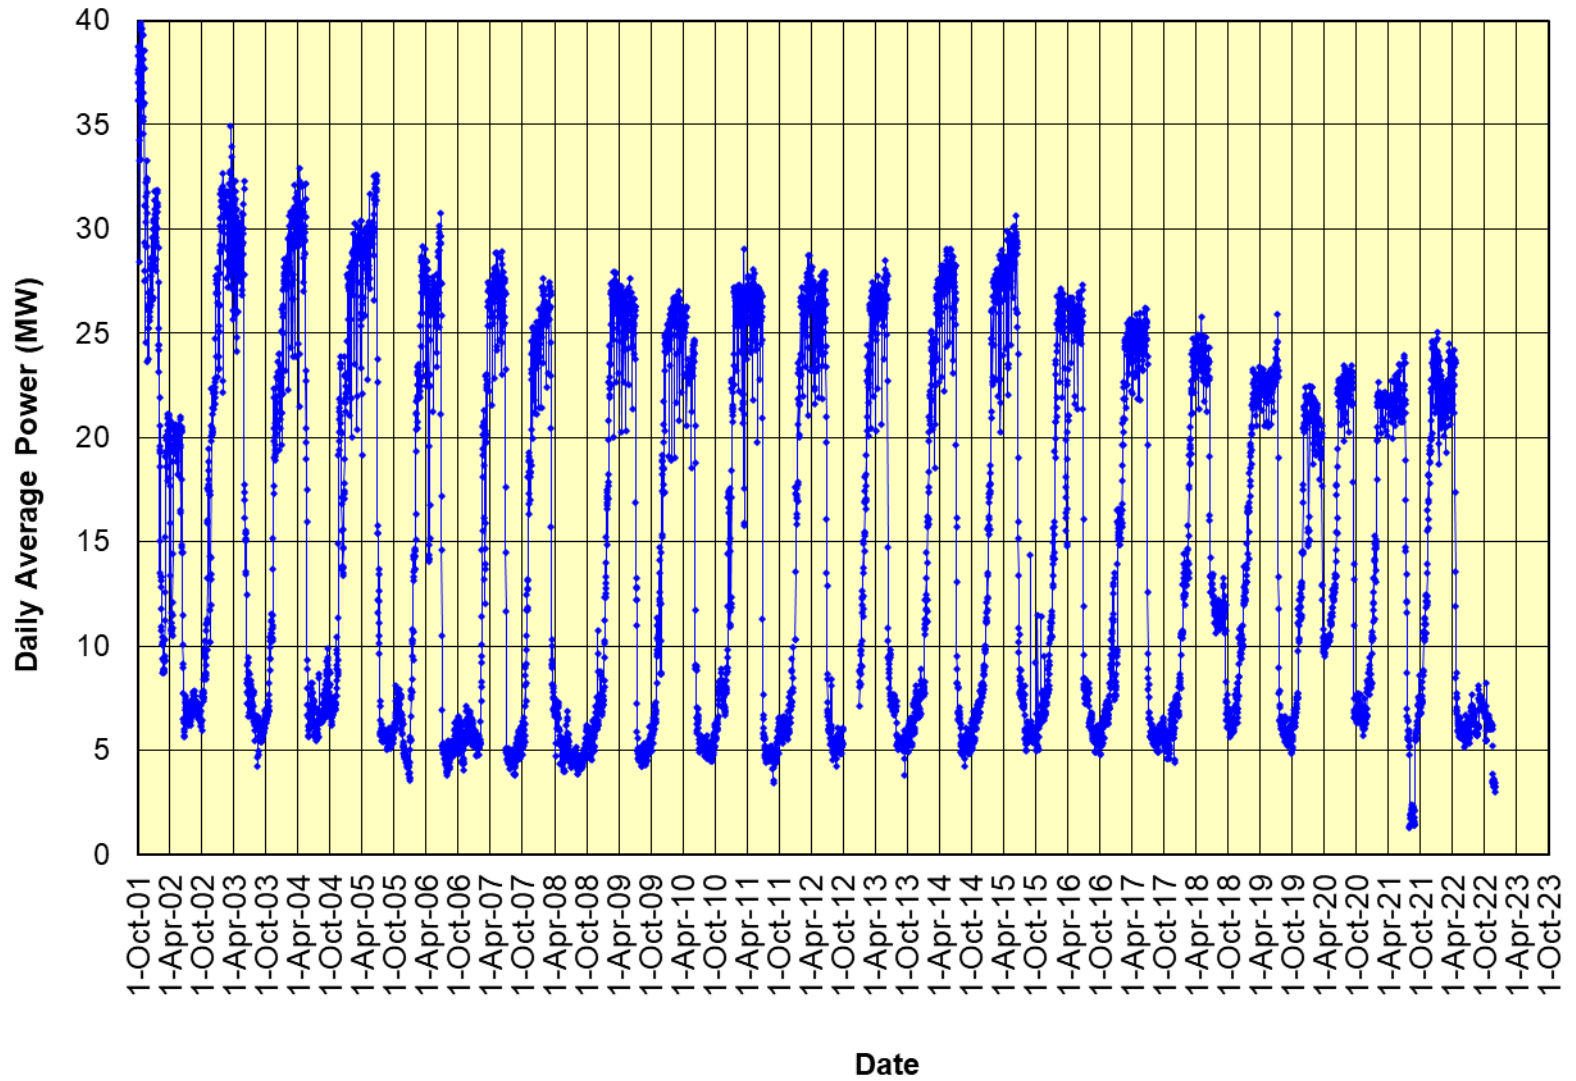

as of 30 November 2022


C-AD Cryo Energy Use FY 2002-23

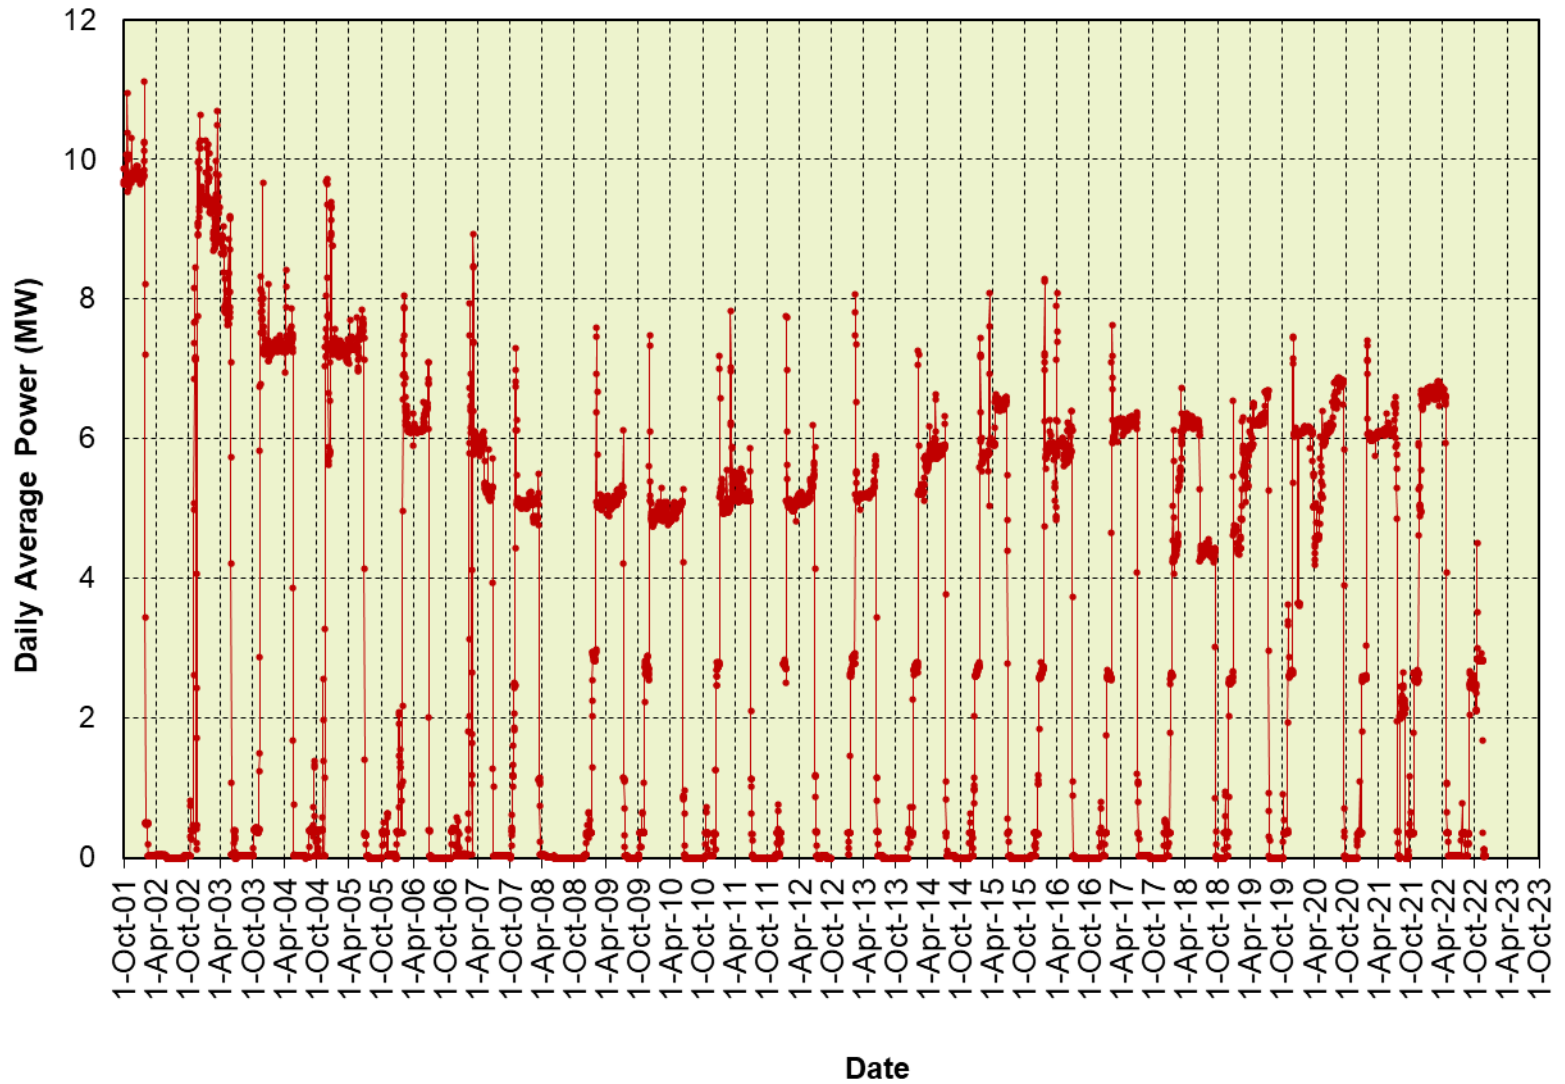

BNL Energy Use FY 2012-23

as of 30 November 2022


- RHIC Cryo
- Booster
- CAD Bldg less SMD
- BNL Peak-Av
- RHIC other
- AGS-Mach
- NSRL
- AGS-Exp
- Tandem
- Site Base

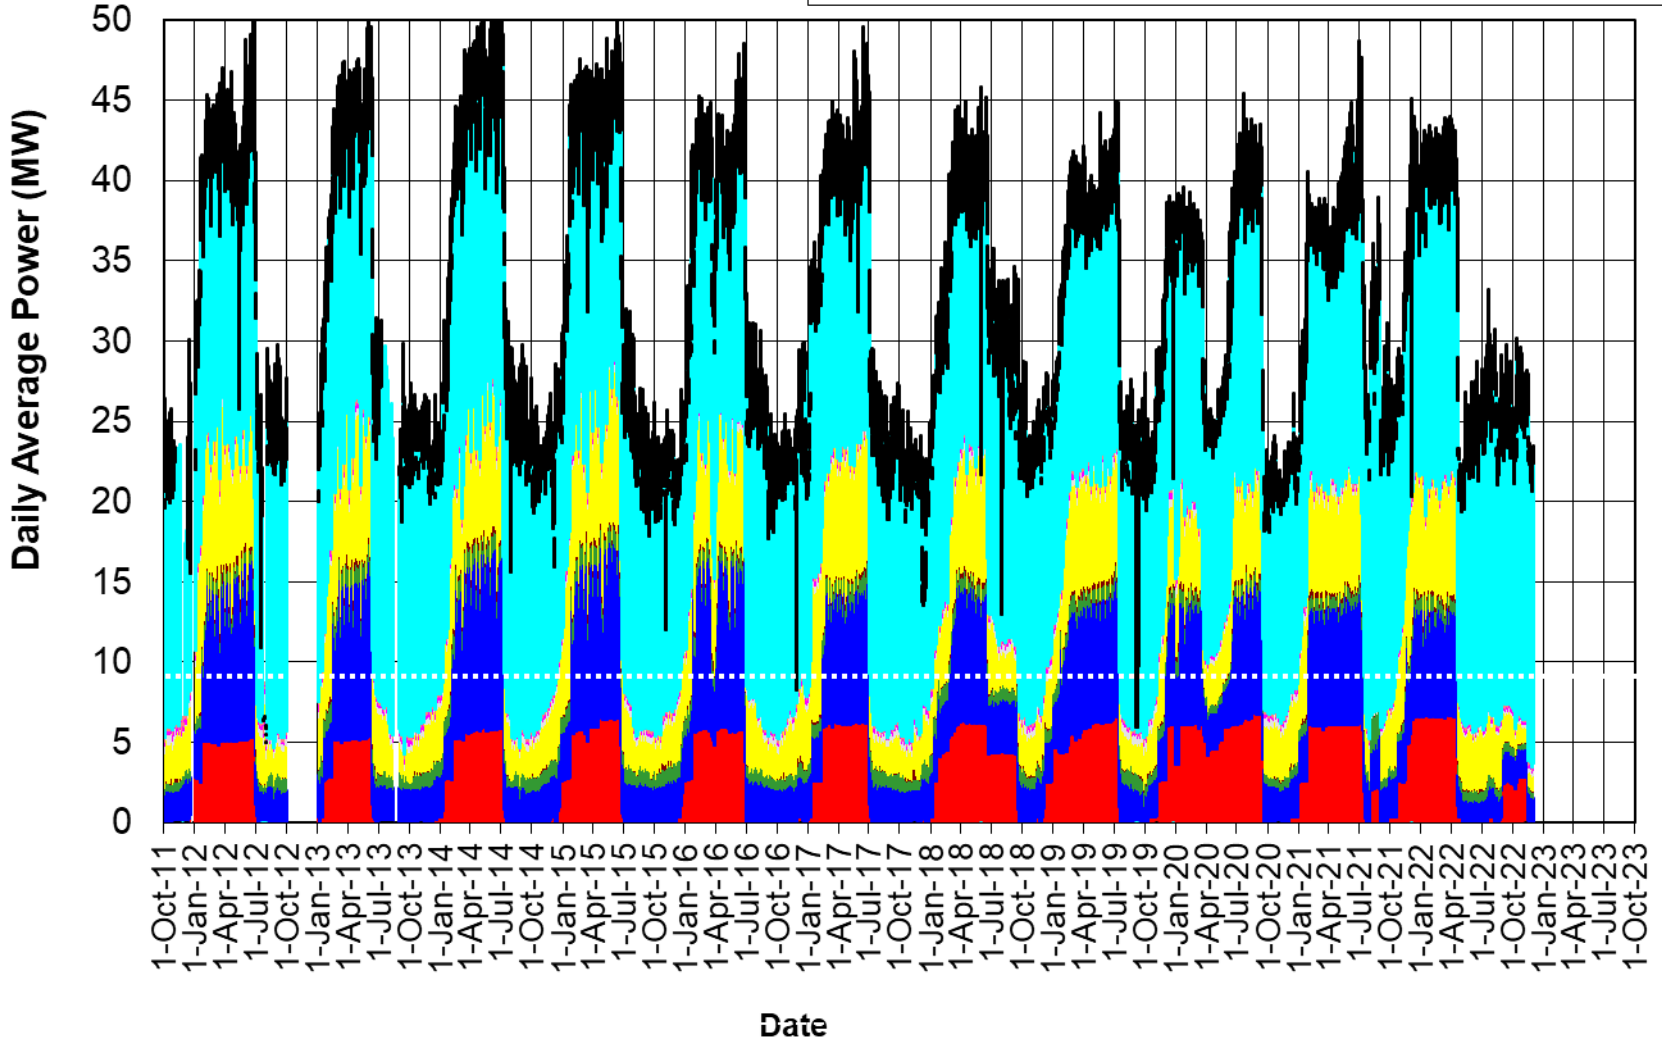

BNL Energy Cost

thru November 2022

- ◆ Billed Cost/MW/hr
- ▲ Without Balanced Billing
- Balanced Billing Projection
- ✱ RHIC ON
- AGS SEB/FEB
- + NSRL

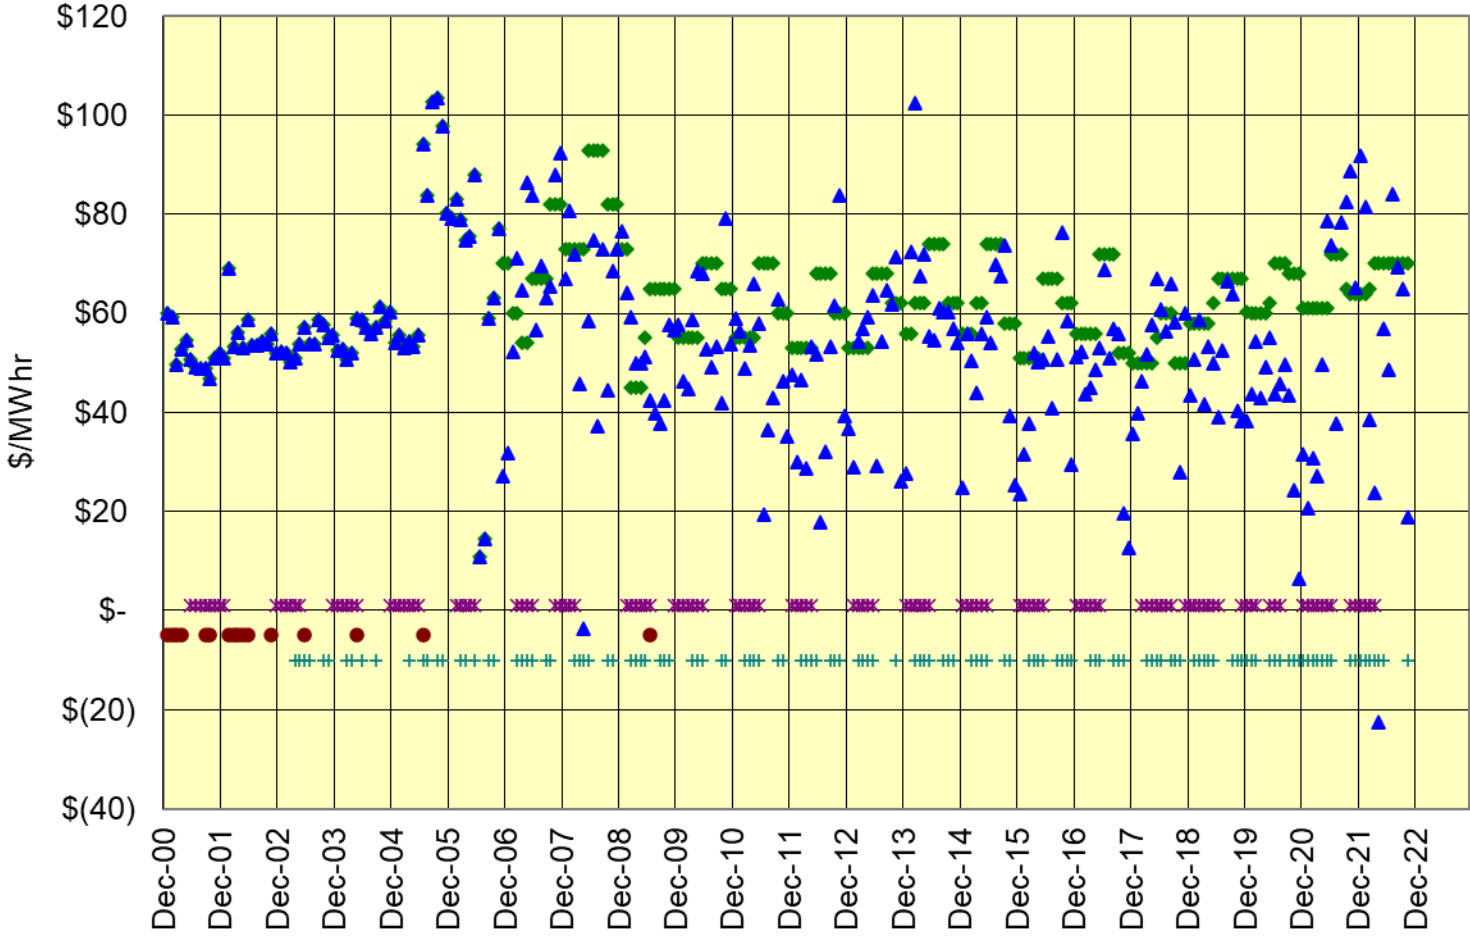

BNL Electricity Cost

