






AGS As Run Schedule, FY1997

By: Ralf Prigl Date: 9-11-97

	Normal Running
	Detector Tests
	Single Cycle on Demand
	Facility Commissioning

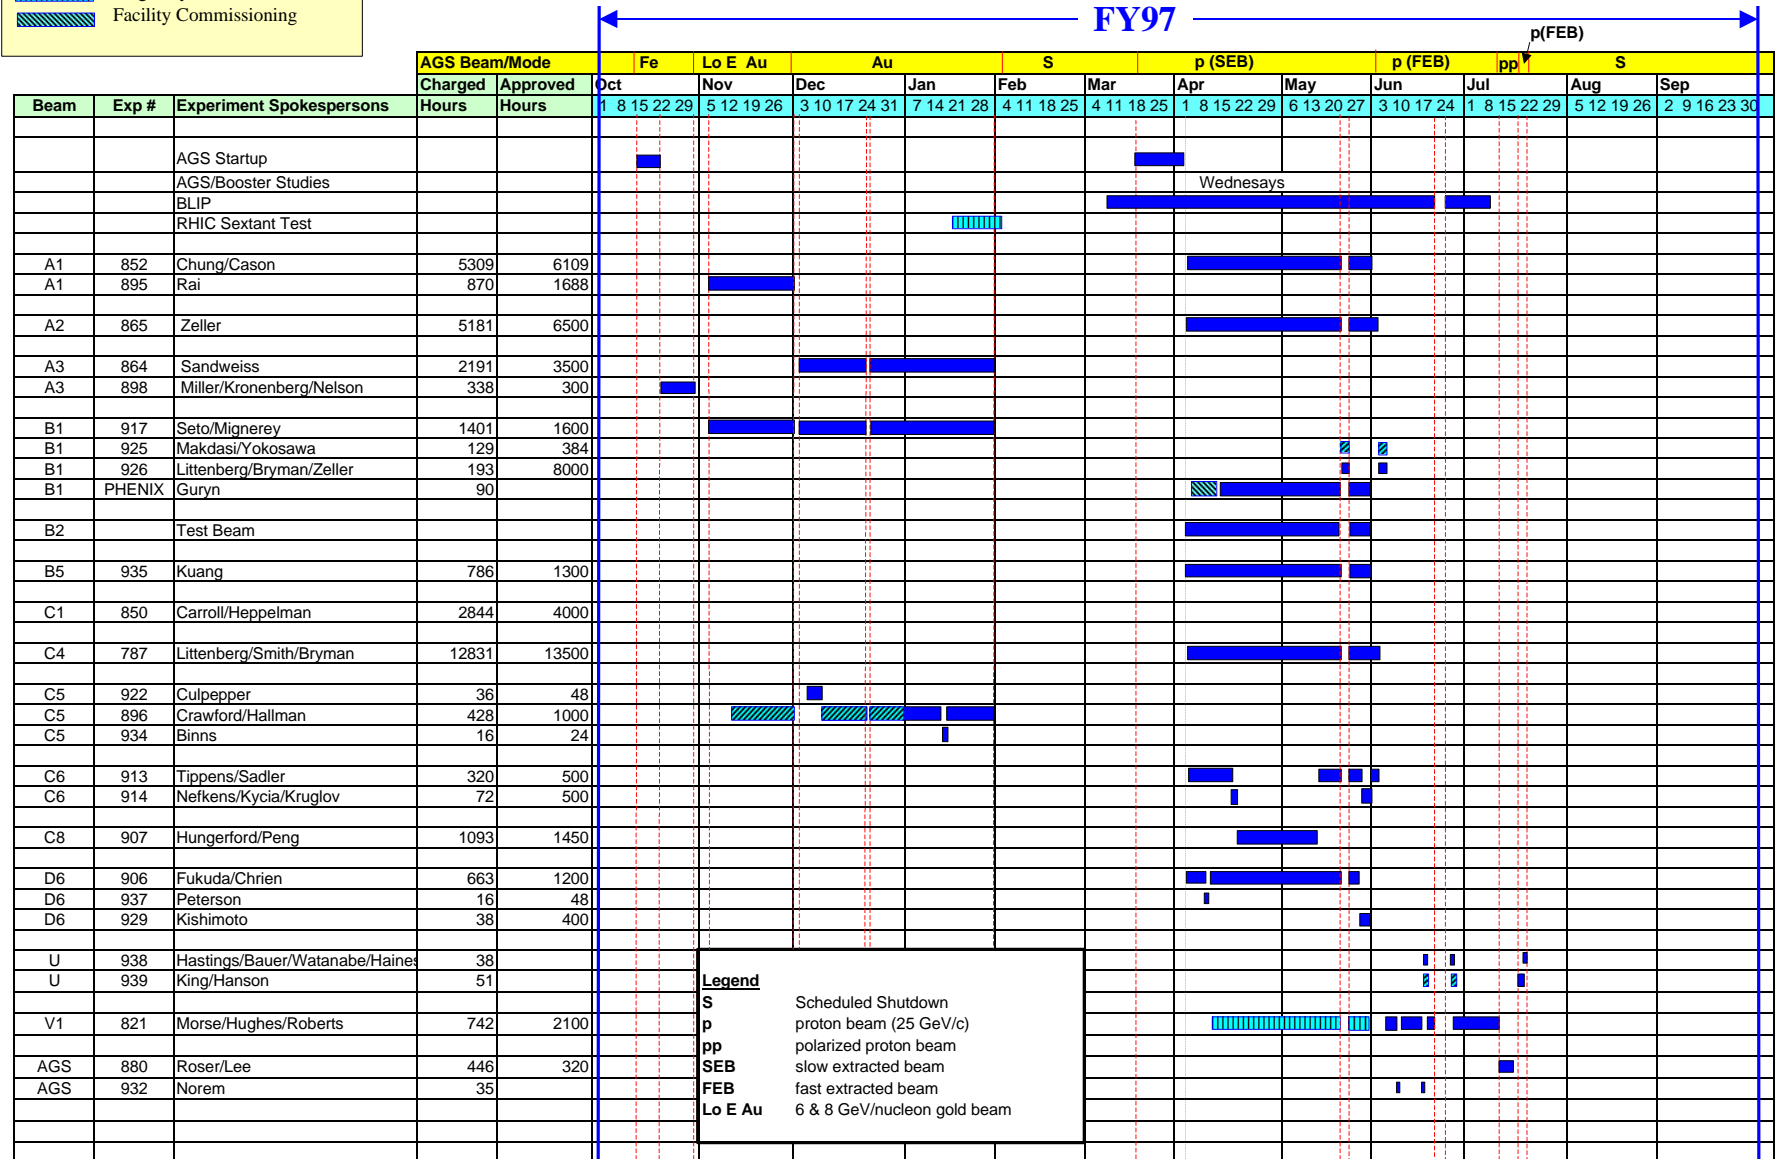

Legend

- S Scheduled Shutdown
- p proton beam (25 GeV/c)
- pp polarized proton beam
- SEB slow extracted beam
- FEB fast extracted beam
- Lo E Au 6 & 8 GeV/nucleon gold beam